

# SFK(H)03

Immersion temperature sensor

**thermokon**<sup>®</sup>  
HOME OF SENSOR TECHNOLOGY

## Datasheet

Subject to technical alteration  
Issue date: 28.06.2022 • A120



### » APPLICATION

Immersion sensor in enclosure form B integrated thermowell pocket for high temperature measurement of liquids in duct applications. Types SFKH03 with a 70 mm neck pipe are designed for applications with insulation materials.

### » TYPES AVAILABLE

#### Immersion sensor temperature – passive

- SFK(H)03 <sensor> <xxx>.08

#### Immersion sensor temperature – active TRV 0..10 V | TRA 4..20 mA

- SFK(H)03 TRVx <xxx>.08
- SFK(H)03 TRA x <xxx>.08

<Sensor>: PT100/PT1000/NI1000/NI1000TK5000/LM235Z/NTC.../PTC...other sensors on request

<xxx>: mounting length 50/100/150/200/250/450 mm

TRVx | TRA x: Product types with different measuring ranges available

### » SECURITY ADVICE – CAUTION

The installation and assembly of electrical equipment should only be performed by authorized personnel.



The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

### » PRODUCT TESTING AND CERTIFICATION



#### Declaration of conformity

The declaration of conformity of the products are available on our website <https://www.thermokon.de/>.

## » NOTES ON DISPOSAL



As a component of a large-scale fixed installation, Thermokon products are intended to be used permanently as part of a building or a structure at a pre-defined and dedicated location, hence the Waste Electrical and Electronic Act (WEEE) is not applicable. However, most of the products may contain valuable materials that should be recycled and not disposed of as domestic waste. Please note the relevant regulations for local disposal.

## » GENERAL REMARKS CONCERNING SENSORS

Especially with regard to passive sensors in 2-wire conductor versions, the wire resistance of the supply wire has to be considered. If necessary the wire resistance has to be compensated by the follow-up electronics. Due to self-heating, the wire current affects the measurement accuracy, so it should not exceed 1 mA.

When using lengthy connection wires (depending on the cross section used) the measuring result might be falsified due to a voltage drop at the common GND-wire (caused by the voltage current and the line resistance). In this case, 2 GND-wires must be wired to the sensor - one for supply voltage and one for the measuring current.

Sensing devices with a transducer should always be operated in the middle of the measuring range to avoid deviations at the measuring end points. The ambient temperature of the transducer electronics should be kept constant. The transducers must be operated at a constant supply voltage ( $\pm 0,2$  V). When switching the supply voltage on/off, onsite power surges must be avoided.

## » BUILD-UP OF SELF-HEATING BY ELECTRICAL DISSIPATIVE POWER

Sensors with electronic components always have a dissipative power, which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. This dissipative power has to be considered when measuring temperature. In case of a fixed operating voltage ( $\pm 0,2$  V) this is normally done by adding or reducing a constant offset value.

Thermokon transducers can be operated with variable operating voltages. The transducers are set at the factory with a reference operating voltage of 24 V =.

At this voltage, the expected measuring error of the output signal will be the least. Other operating voltages, can cause a measurement deviation changing power loss of the sensor electronics.

A recalibration can be carried out directly on the unit or via a software variable (app or bus).

**Remark: Occurring draught leads to a better carrying-off of dissipative power at the sensor. Thus temporally limited fluctuations might occur upon temperature measurement.**

## » TECHNICAL DATA

Measuring values	temperature		
Medium	gases, fluids		
Output voltage <i>(type-dependent)</i>	<b>TRV</b> 1x 0..10 V, min. load 5 k $\Omega$		
Output ampere <i>(type-dependent)</i>	<b>TRA</b> 1x 4..20 mA, max. load 500 $\Omega$		
Output passive <i>(type-dependent)</i>	<b>passive</b> PT100   PT100 1/3 DIN   PT1000   PT1000 1/3 DIN   Ni1000   Ni1000TK5000, NTC10k   NTC 10k Precon   NTC20k   NTC1,8k, LM235Z		
Power supply <i>(type-dependent)</i>	<b>TRV</b> 15..35 V = or 15..26 V ~ SELV	<b>TRA</b> 15..24 V = ( $\pm 10\%$ ) SELV	
Power consumption <i>(type-dependent)</i>	<b>TRV</b> typ. 1 W (24 V =)   1,4 VA (24 V ~)	<b>TRA</b> typ. 0,5 W (24 V =)	
Measuring range temp. <i>(type-dependent)</i>	<b>passive</b> PT / Ni: -50..+160 °C (T160), optional -80..+260 °C (T260), NTC: -50..+150 °C (T150), LM235Z: -50..+120 °C (T120)		
Output signal range temp. <i>*Scaling analogue output (type-dependent)</i>	<b>TRV   TRA</b> TRV1   TRA1: -50..+50 °C, TRV2   TRA2: -10..+120 °C, TRV3   TRA3: 0..+50 °C, TRV4   TRA4: 0..+160 °C, TRV5   TRA5: 0..+300 °C		
Operating temperature range <i>*Max. permissible operating temp</i>	<b>sensor pocket</b> -50..+160 °C optional -80..+260 °C	<b>enclosure – TRV TRA</b> -35..+70 °C	<b>enclosure - passive</b> -35..+90 °C
Accuracy temperature <i>(type-dependent)</i>	<b>TRV   TRA</b> $\pm 0,2$ K or $\pm 0,1$ % (whatever is greater, typ. at 21 °C)		<b>passive</b> depending on used sensor Sensor, PT100   PT1000: $\pm 0,3$ K (typ. bei 0 °C, Kl.B) , Ni1000: $\pm 0,4$ K (typ. bei 0 °C), Ni1000TK5000: $\pm 0,4$ K (typ. bei 0 °C), NTC10K: $\pm 0,22$ K (typ. bei 25 °C)
Sensor <i>(type-dependent)</i>	<b>passive</b> 2-wire (standard), 3-wire or 4-wire		






<b>Enclosure</b>	shape B, aluminium
<b>Protection</b>	IP66 according to EN 60529, SI-Protection
<b>Cable entry</b>	M20, for wire Ø=8 mm
<b>Connection electrical</b>	terminal block, max. 1,5 mm <sup>2</sup>
<b>Neck pipe (optional)</b>	stainless steel V2A, Ø=15 mm, L=70 mm
<b>Pocket</b>	stainless steel V4A, Ø=8 mm, mounting length: 100   150   200   250 mm, thread G 1/2" max. operating pressure 40 bar (580,15 psi)
<b>Ambient condition</b>	max. 85% rH short term condensation

» **MOUNTING ADVICES**


For risk of condensate permeation in the sensor tube respectively in the immersion pocket the bushing must be installed in a position that occurred condensate can run off.

» **CONNECTION PLAN**

**Attention:** With digital sensors such as **AD592, SMT160, LM235, DS1820** the following applies: brown= plus (+), white= minus (-) ,green=out

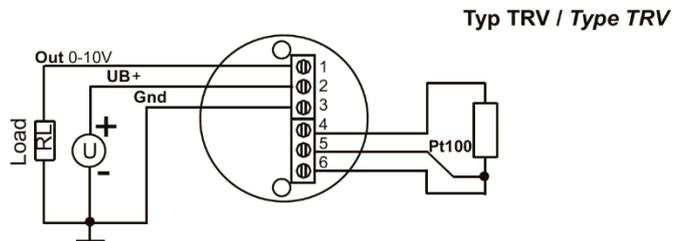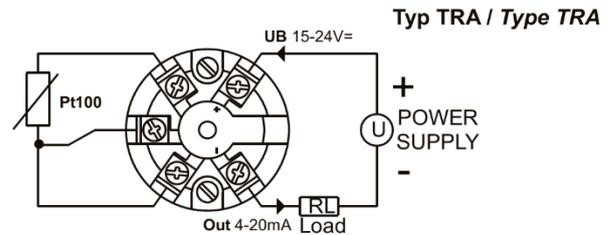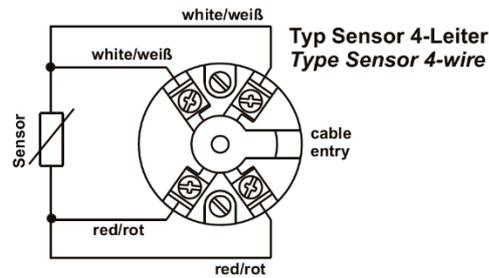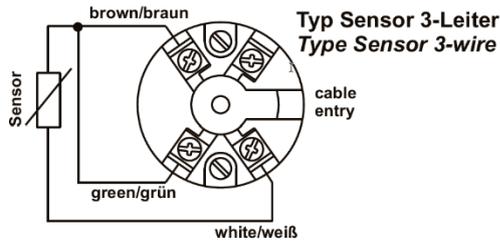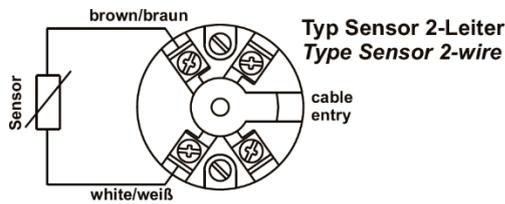

## » DIMENSIONS (MM)

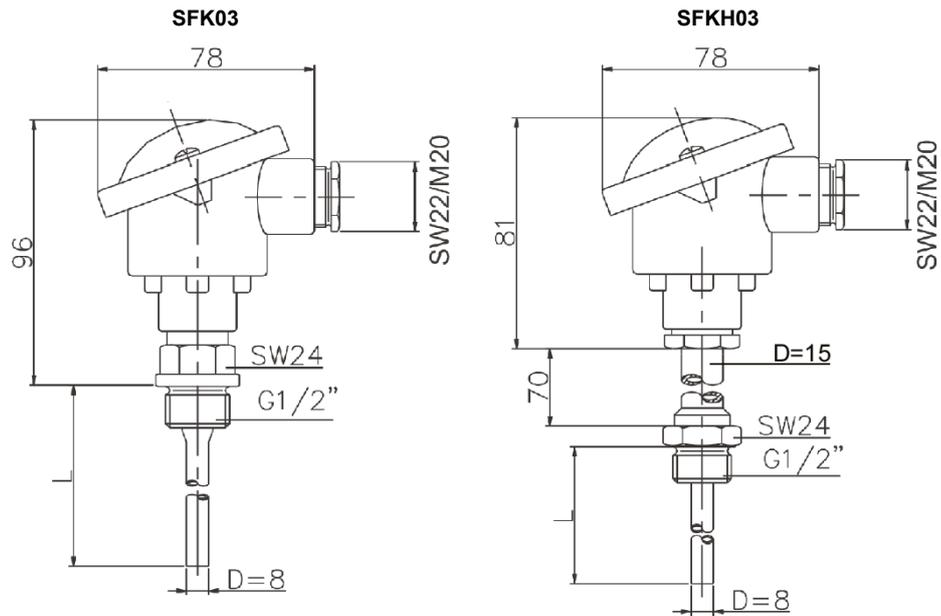

## » ACCESSORIES (OPTIONAL)

Bonded pocket type ESH60 for mounting length 50 mm  
 Bonded pocket type ESH110 for mounting length 100 mm  
 Bonded pocket type ESH160/170 for mounting length 150 mm  
 Bonded pocket type ESH210 for mounting length 200 mm  
 Bonded pocket type ESH260 for mounting length 250 mm

Item No. 319096  
 Item No. 103459  
 Item No. 103466  
 Item No. 103473  
 Item No. 173247