

**Description**

**JOY**  
**Fan Coil Thermostat**

## Introduction

## Revision

Revision	Date	Description
3	09.12.2015	Issued
4	19.01.2016	Valid with Software version 1.0.12++ <ul style="list-style-type: none"> <li>- Fan coil assignment to controller mode</li> <li>- Locking of fan coil keys</li> <li>- Override heating/cooling outputs</li> <li>- Cleaning mode</li> <li>- °C/°F display switching</li> <li>- ON/OFF delay</li> <li>- Max heating and coolin loads configurable</li> </ul>
5	19.07.2016	Valid with Software version 1.0.14++ <ul style="list-style-type: none"> <li>- Added hint: Only output heating is active when using change-over</li> <li>- Additional controller modes:               <ul style="list-style-type: none"> <li>- Manual heat respectively cool mode triggering both outputs</li> <li>- Auto heat mode triggering both outputs</li> <li>- Auto cool mode triggering both outputs</li> </ul> </li> </ul>
6	06.09.2016	Correction of register 6-8 order in chapter 4.1
7	14.11.2016	Valid with application firmware version 1.1.0++ <ul style="list-style-type: none"> <li>Added PI-controller</li> <li>Added EC-fan coil type</li> <li>Added Startup time fan coil</li> <li>Added Display set point adjustment</li> <li>Added Keycard mode</li> <li>Added Display of controller mode</li> <li>Added Input register "Controller mode"</li> <li>Added Display automatic mode in Input Register "State fan coil"</li> </ul> Configuration software version 1.2.0.0++
8	18.01.2017	Valid with application firmware version 1.3.0++ and configuration software version 1.3.0.0++ <ul style="list-style-type: none"> <li>New: Time and date can be faded out</li> <li>New: Display set point offset in main screen</li> <li>New: Special functions for ON-/OFF-Key</li> <li>New: Display application firmware version</li> </ul>

1	DEVICE TYPES OVERVIEW .....	4
2	GENERAL.....	4
2.1	Device description .....	4
2.2	Configuration software .....	5
2.3	Hardware Installation .....	5
2.4	RS485 Transceiver .....	5
2.5	Protocol.....	5
2.6	SD-Card.....	5
2.7	Boot Loader .....	5
2.8	Start screen.....	6
3	MENU GUIDANCE .....	7
3.1	Main Menu .....	7
3.2	Parameter Menu .....	12
3.3	Cleaning mode .....	15
3.4	°C/°F display switching .....	15
3.5	Special function of keys.....	16
4	FUNCTIONS.....	17
4.1	General Settings.....	17
4.2	Time and Date.....	19
4.3	Time Channel .....	21
4.4	Temperature.....	25
4.5	Inputs .....	26
4.6	Alarm.....	30
4.7	Set point .....	31
4.8	Fan coil stages.....	35
4.9	Keycard Switch .....	41
4.10	Occupancy .....	41

**Description of Thermostat JOY**

---

4.11	Dewpoint.....	42
4.12	Window Contact/Energy Lock .....	43
4.13	Change-Over .....	45
4.14	Controller.....	46
5	MODBUS REGISTER REFERENCE.....	53
5.1	3 stages fan coil type (3 relays).....	53
5.2	Input Register.....	56
5.3	EC- fan coil type (0-10V).....	57
5.4	Input Register.....	60
6	CONFIGURATION SOFTWARE.....	61
6.1	Connection to the PC.....	61
6.2	Start screen.....	61
6.3	Determine firmware version .....	62
6.4	Overview .....	62
6.5	Appendix.....	65
6.6	Supported Control Commands .....	65
6.7	Data Transmission .....	65

## 1 Device Types Overview

JOY Fancoil 3DI	Ord.-Nr. 614757	(3 fan coil stages)
JOY Fancoil Modbus	Ord.-Nr. 614771	(3 fan coil stages)
JOY Fancoil_EC 3DI	Ord.-Nr. 649889	(EC-fan coil 0-10V)
JOY Fancoil_EC Modbus	Ord.-Nr. 648363	(EC-fan coil 0-10V)

## 2 General

### 2.1 Device description

Modern design, flush mounting fan coil room thermostat. Used for individual control of temperature in commercial, industrial and residential buildings. It is tailored for two-pipe and four-pipe fan coil units with two-wire electric valves. The device combines a modern design with a 2,5" LCD and a touch sensitive surface, 3 time channel options each with 4 time periods options.



## 2.2 Configuration software

Thermokon provides a configuration software free of charge which can be downloaded from our website. This software enables the user to create parameter files for the different available device types (3DI and Modbus), which can be stored on a SD card. Remove front panel from device, insert SD card and after power-on device reads and stores a valid parameter file from SD card. Subsequently SD card has to be removed! Devices with integrated Modbus-interface can also be parameterized by using the Modbus interface.

Further information about the configuration software can be found in chapter [6](#).

## 2.3 Hardware Installation

JOY can be connected by means of twisted pair cables (line resistance 120 Ohm). Detailed information on installation and mounting can be obtained in the JOY product data sheet and the data sheet wiring\_rs485\_network.pdf.

## 2.4 RS485 Transceiver

Maximum number of bus participants without use of repeater is defined by the RS485 transceiver. The transceiver used in JOY enables a maximum of 32 devices per bus segment. This constraint is not a timing matter but only for current drive ability of the hardware!

## 2.5 Protocol

JOY is a Slave bus participant which is only allowed to send data upon request of the Master. The protocol corresponds to the defaults of:

- MODBUS application protocol specification V1.1
- MODBUS over Serial Line Specification & Implementation guide V1.0

## 2.6 SD-Card

Micro SD cards can be used to upload a new application or a new device configuration. Further information on uploading process can be found in chapter [Bootloader](#). With the corresponding PC configuration tool a configuration file can be created and uploaded via SD card. Read more in chapter [Configuration Software](#). Devices from firmware version 1.3.0++ indicate on start screen if an invalid parameter file is found on plugged-in SD card!

SDHC-cards cannot be used!

## 2.7 Boot Loader

Because of an integrated bootloader a new application (update) can be uploaded by means of a SD card. To insert the SD card, the housing cover must be removed. If the boot loader is activated, the ring illumination blinks in a 1s cycle, while display is not triggered! After recognition of a SD card with a valid application the update process is started. Now, ring illumination blinks in a 300ms cycle. After a successful update process (Duration circa 2-3 minutes!) the new application is started automatically. **Afterwards, SD card shall be removed!**

## 2.8 Start screen

After power-up or switching from standby to normal mode (button ON/OFF) a start screen is faded in for about 5s, showing information about device type and application firmware version.




Picture 1: View main screen

### 3 Menu Guidance

#### 3.1 Main Menu

##### 3.1.1 Keys

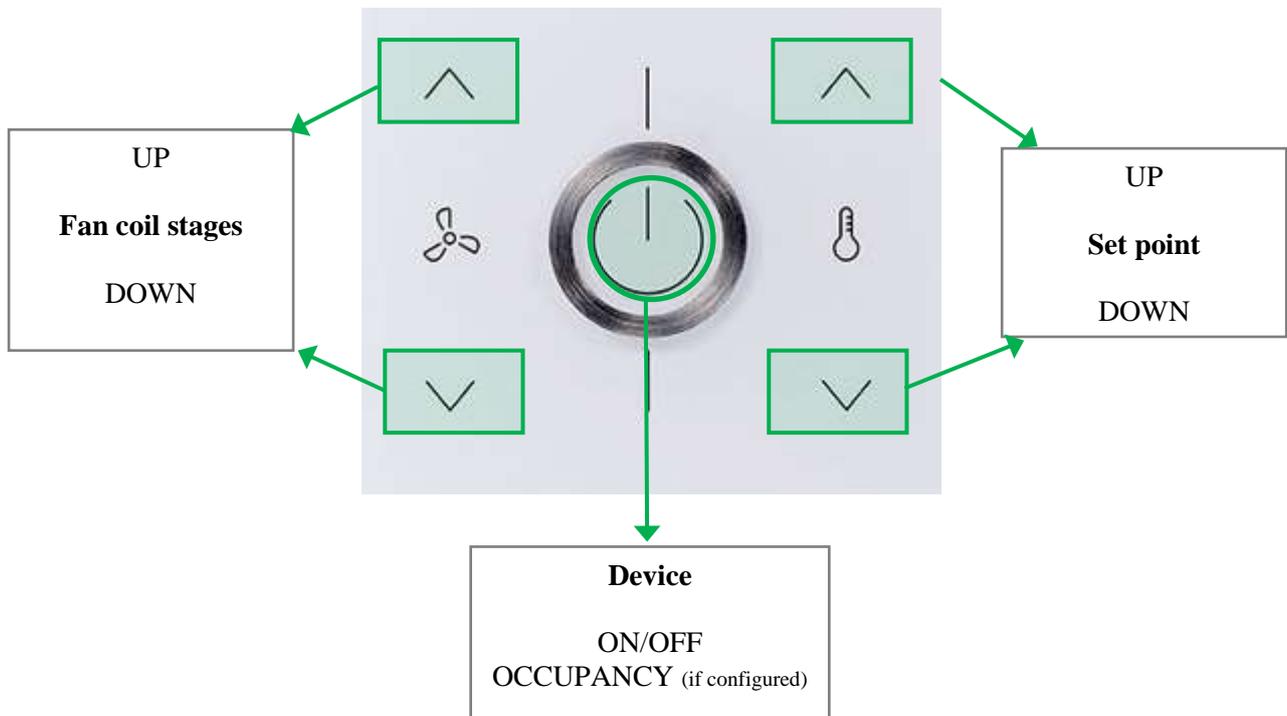

Single key actuation releases an action. A longer key actuation enables a cyclical change of the value in 1s cycle. After having pressed the key for approx. 3s, the cycle time is decreased. Standby mode can be enabled by actuating key ON/OFF for at least 2s. A short key press modifies the occupancy state, if this feature is configured ([see Chapter 3.5](#)). In standby mode display and outputs are switched off (controller deactivated). Frost and heat protection remain active. Switching to standby mode is only possible if no digital input is configured as keycard switch.

In case of switching from OFF- to ON-state the start screen is shown for about 5s, displaying device type, application firmware version and build date).

### 3.1.2 Main Screen

The main screen is divided in three fields: header, value screen and footer.



Picture 2: View main screen

#### Header

The header is designed for displaying time, weekday and date. In addition an info symbol is displayed upon requirement or depending on certain states/modes.



Picture 3: Main screen header

The positions are pre-defined and cannot be changed.

#### Info Symbols

- ECO Mode
- Alarm

#### Value Screen

As a standard the value screen shows the room temperature measured by an integrated sensor. If an external sensor is connected and the input is configured accordingly, this value will be indicated in the display. It can be parameterized if room temperature or set point shall be displayed.



Picture 4: Temperature display in value range

Upon actuation of any arrow key the display of the value screen changes and shows the associated value. The arrow keys above and under the set point symbol are leading to the set point adjustment screen - the arrow keys above and under the fan coil stage symbol to the fan coil stage adjustment screen. The display switches back to standard screen after 20s without key actuation.

*Display of Set point***Picture 5: Display of set point adjustment**

After actuation of the arrow keys for set point adjustment, the display screen changes to the set point adjustment screen. The set point symbol and the set point offset value are displayed. Another actuation of one of the two arrow keys modifies the value. There are three options available for the adjustment mode of the set point. It is possible to adjust the same as an offset value, as an effective value or in stages. As for the display in stages, the values -3, -2, -1, 0, 1, 2, 3 are indicated. Which set point jump corresponds to the individual stages can be set by means of the parameter set point step size (register 21). The parameter of the set point adjustment range (register 21) has to be adjusted in this way that the value corresponds to stage 3.

See chapter [Set point](#).

*Display of fan coil stages***Picture 6: Display of fan coil stage adjustment**

After actuation of any arrow key for fan coil stage adjustment, the indication of the value screen changes to fan coil stage adjustment screen. Fan coil stage symbols and the current fan coil stage are displayed. Another actuation of any arrow key switches the fan coil stage.

**Footer**

In the footer, symbols for process-oriented states such as heating, cooling, room occupancy, window contact etc. are displayed. The symbols are divided into symbol groups. Only one symbol per group can be displayed at the same time.

*Symbol Groups*

Occupancy		
Window contact/dew point		
Heating/cooling		
Fan coil stage		
Active time channel		

Five fields are available.



**Picture 7: Main screen footer example**

Moreover, the positions of the symbols can be freely chosen.

Picture 7 shows a possible configuration. The symbol group fan coil stage is always faded-in, the symbols of group Heating/Cooling only when the controller is in the corresponding mode. The groups Window Contact/Dew Point and Occupancy are only faded-in, if the corresponding mode is configured via an input or set via Modbus. Refer to chapter Inputs. The symbol “Active time channel” is only displayed if a channel is active and no set points are indicated via Modbus.

**3.1.3 Holding Register**

Modbus Holding Register	
Register Data Address	Description
10	(#) Display main screen  Default: 0x00 <sub>hex</sub> : Room temperature display  Value range: 0x00 <sub>hex</sub> : Room temperature display 0x01 <sub>hex</sub> : Set point base display 0x02 <sub>hex</sub> : Set point offset display


11	(#) Footer symbol 1  Default: 0x00 <sub>hex</sub> : No symbol  Value range: 0x00 <sub>hex</sub> : No symbol 0x01 <sub>hex</sub> : Heating/cooling 0x02 <sub>hex</sub> : Occupancy 0x03 <sub>hex</sub> : Window contact/dew point 0x04 <sub>hex</sub> : Fan coil stage 0x05 <sub>hex</sub> : Active time channel
12	(#) Footer symbol 2  Default: 0x00 <sub>hex</sub> : No symbol  Value range: See symbol 1
13	(#) Footer symbol 3  Default: 0x00 <sub>hex</sub> : No symbol  Value range: See symbol 1
14	(#) Footer symbol 4  Default: 0x00 <sub>hex</sub> : No symbol  Value range: See symbol 1
15	(#) Footer symbol 5  Default: 0x00 <sub>hex</sub> : No symbol  Value range: See symbol 1
114	(#) Display set point adjustment  Default: 0x00 <sub>hex</sub> : Set point offset  Value range: 0x00 <sub>hex</sub> : Set point offset 0x01 <sub>hex</sub> : Set point base 0x02 <sub>hex</sub> : Set point stages (-3,-2, -1, 0, +1, +2,+3)

**The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime !**

## 3.2 Parameter Menu

### 3.2.1 Keys

Parameter mode is entered by the key combination shown in picture 8. The parameter mode enables the user to adapt the time channel parameter (Modbus and 3DI devices) and additional parameters, like Time, Date, Input configuration,... (only 3DI devices) to own requirements directly at the device. In an additional menu the Modbus parameters can be modified by installer/system integrator.

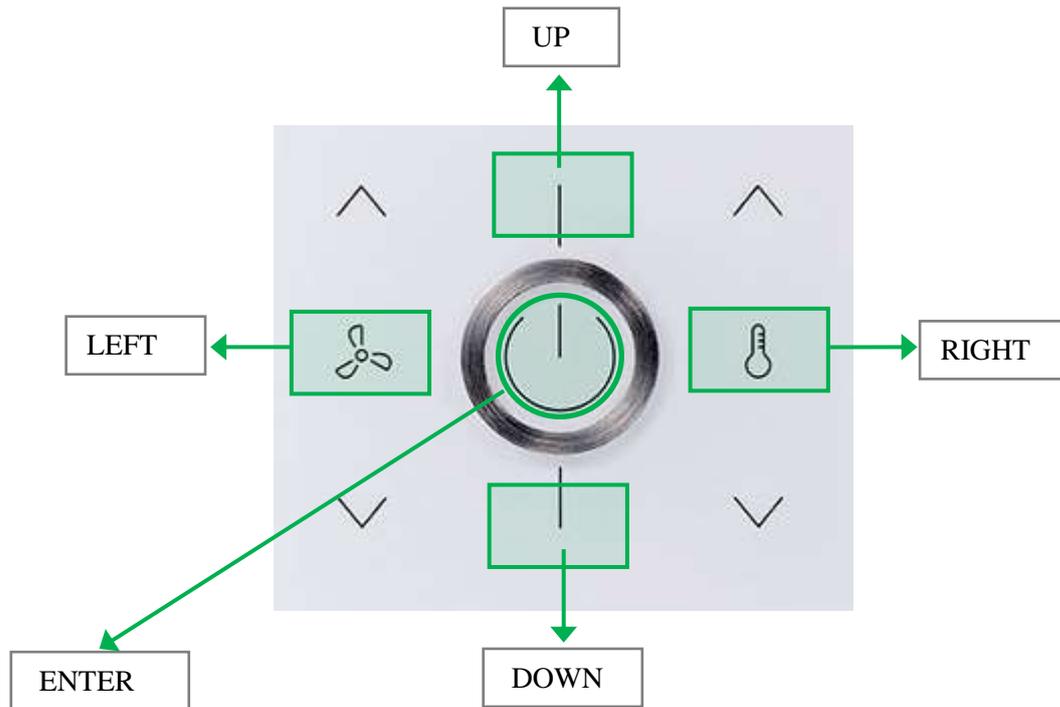

Picture 8: Keys in parameter menu

### 3.2.2 Enter Parameter Menu

Simultaneous actuation of marked keys for at least 5s.




Picture 9: Key combination to invoke parameter menu

### 3.2.3 Exit Parameter Menu

The parameter menu can be left by choosing the header in the main screen of the parameter menu and a key "LEFT" press afterwards. An automatic return to main menu is effected if no key is pressed in parameter menu for 30s.

### 3.2.4 Navigation

Navigation in menus is made via the keys UP, DOWN, LEFT, RIGHT and ENTER. The menus are build-up hierarchically. Highest level is the main menu. From main menu the user can jump to different submenus. From there, further submenus (if existing) can be entered. To return to previous level, the header must be selected and key LEFT must be actuated afterwards. The keys UP/DOWN are used for selection of a menu line. The currently selected menu line is displayed inverted. A modification of a value can only be made in the selected menu line.

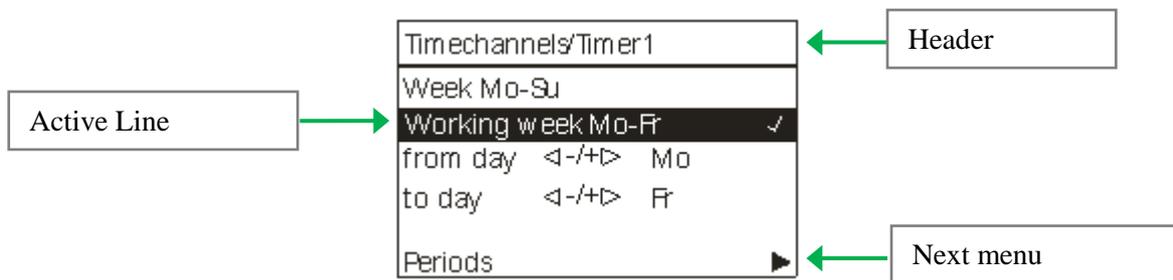

Picture 10: Example of a menu page

The following symbols are used in the menu and enable a better orientation during navigation through the menus:

#### Value Change

<-/+> The value can be changed by means of keys LEFT(-)/RIGHT(+). No selection via ENTER key necessary.

#### Invoke next Menu

▶ The next menu can be invoked by means of key RIGHT.


#### Selection of Display Value

✓ The symbol is faded-in if corresponding value is selected accordingly. Parameters for which no symbol for value change <-/+> is shown can be selected with key ENTER.

### 3.2.5 Overview Parameter Menu

#### 3.2.5.1 Menu time channel

After actuation of the key combination mentioned earlier in chapter **Enter Parameter Menu** the following menu is shown:

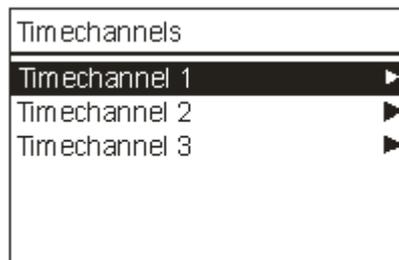

Picture 11 Menu „Choose time channel“

Further information on the parameterization of the time channels can be found in chapter **Time channel**. Up to three time channels with four periods each can be parameterized.

#### 3.2.5.2 Menu Modbus parameter

The menu for Modbus parameter setting is invoked by a simultaneous actuation of the keys marked below for at least 5s. To access the menu for Modbus settings by means of the mentioned key combination, the header must be activated in the main menu of the time channels!!



Picture 12 Activated header in main menu of timechannels



Picture 13 Key combination for call of menu Modbus parameter

Afterwards the following Menu appears:

Modbus settings		
Address	◀-/▶	32
Baudrate	◀-/▶	38400
Parity	◀-/▶	None

Picture 14: Overview parameter menu modbus

### Address

Device address in Modbus network. Adjustable addresses 1-247.

### Baud Rate

9600Bd  
19200Bd  
38400Bd  
57600Bd


### Parity

None  
Odd  
Even

## 3.3 Cleaning mode



By actuating key  for at least 3s, cleaning mode can be entered. All keys are locked. Cleaning mode remains active for 60s.

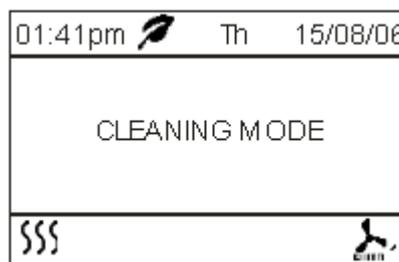

Picture 15: Cleaning mode screen

## 3.4 °C/°F display switching



By actuating key  for at least 3s, the temperature unit displayed on screen can be switched between °C and °F. Only screen display is affected! The temperature unit of parameter and process data maintain the unit parameterized in register 6 (UNIT TEMPERATURE).

### 3.5 Special function of keys

The center key can be configured with different functionalities. A short key press triggers the special function. A long key press still triggers the ON/OFF function, except if function *Locked* is set. In this case the key is completely locked.

Modbus Holding Register (R/W)	
Register Data Address	Description
115	(#) Special function of key ON/OFF  Default: 0x0000 <sub>hex</sub> : no special function  Value range: 0x00 <sub>hex</sub> = no special function (ON/OFF active) 0x01 <sub>hex</sub> = Toggle occupancy 0x02 <sub>hex</sub> = Occupied 0x03 <sub>hex</sub> = Unoccupied 0xFF <sub>hex</sub> = Locked (ON/OFF disabled)

## 4 Functions

### 4.1 General Settings

Menu language and a code for device location identification can be configured. Also brightness of background illumination for LCD and ring can be configured in the range of 0-100%. Furthermore, all keys or only fan coil keys can be locked via Modbus and the device can be switched off to standby mode. In standby mode controller is not active and display is off. Moreover, all outputs are switched off and the keys are locked (except for ENTER). Switching to standby mode is only possible if no digital input is configured as keycard switch.

#### 4.1.1 Holding Register

##### Max heating load

Implemented to optimize self-heating compensation with switched load. When stating the value, the load of the fan must be considered in addition to the occurred load of the heating valve, if a triggering of the fan in the heating phase is feasible.

##### Max cooling load

The same applies here.

Modbus Holding Register (R/W)	
Register Data Address	Description
2	(#) Device location identification  Default: 0x00 <sub>hex</sub>  Value range: 0x0000 <sub>hex</sub> - 0xFFFF <sub>hex</sub>
3	(#) Language  Default: 0x00 <sub>hex</sub> : German  Value range: 0x00 <sub>hex</sub> : German 0x01 <sub>hex</sub> : English
16	(#) Brightness background illumination LCD  Default: 90 <sub>dez</sub> = 90%  Value range: 0-100 <sub>dez</sub> = 0-100%

17	(#) Brightness ring  Default: $20_{\text{dez}} = 20\%$  Value range: $0-100_{\text{dez}} = 0-100\%$
99	(#) Max heating load  Default: $0x00_{\text{hex}} = <2A$  Value range: $0x00_{\text{hex}} = <2A$ $0x01_{\text{hex}} = <4A$ $0x02_{\text{hex}} = <6A$
100	(#) Max cooling load  Default: $0x00_{\text{hex}} = <2A$  Value range: $0x00_{\text{hex}} = <2A$ $0x01_{\text{hex}} = <4A$ $0x02_{\text{hex}} = <6A$
261	Device On/Off  Default: $0x00_{\text{hex}}$ : On  Value range: $0x00_{\text{hex}}$ : On $0x01_{\text{hex}}$ : Off
262	Release of keys  Default: $0x00_{\text{hex}}$ : Released  Value range: $0x00_{\text{hex}}$ : Released $0x01_{\text{hex}}$ : Lock all keys $0x02_{\text{hex}}$ : Lock fan coil keys

**The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime !**

## 4.2 Time and Date

### 4.2.1 Overview

The room thermostat has a real-time clock, which calculates time and date automatically. Besides daylight saving the presentation formats of time and date can be freely configured. The real time clock is buffered by battery, i.e. time and date are kept even in case of longer power failures.

Time and date can be updated during operation by a supervisory system via Modbus.

### 4.2.2 Holding Register

Modbus Holding Register (R/W)	
Register Data-Address	Description
7	(#) Format time  Default: 0x00 <sub>hex</sub> : 24h(pm)  Value range: 0x00 <sub>hex</sub> : 24h(pm) 0x40 <sub>hex</sub> : 12h(am)
8	(#) Format date  Default: 0x00 <sub>hex</sub> : TT.MM.JJ  Value range: 0x00 <sub>hex</sub> : TT.MM.JJ 0x01 <sub>hex</sub> : JJ/MM/TT
97	(#) Daylight saving  Default: 0x01 <sub>hex</sub> : Central european time (CET)  Value range: 0x00 <sub>hex</sub> : disabled 0x01 <sub>hex</sub> : CET
264	Time hour  Default: 12  Adjustable range 0 - 23
265	Time minute  Default: 00  Adjustable range 0 - 59

266	Date day  Default: 01  Adjustable range 1 - 31
267	Date month  Default: 01  Adjustable range 1 - 12
268	Date year  Default: 15  Adjustable range 15 - 99

**The registers marked with # are saved in EEPROM. They shall be written only during configuration and not at runtime !**

## 4.3 Time Channel

### 4.3.1 Overview

There are 3 time channels including 4 periods available, which can be freely programmed. For each time channel a set of weekdays can be selected. Start time, set point, fan coil stage and ECO mode can be parameterized for every period.

**Table 1: Structure of a Time Channel**


Time Channel		
Weekday mask	Periods	Parameters
Complete week Mo-So Working week Mo-Fr From day to day	1	Start time
		Fan coil stage
		Set point heating
		ECO mode
	2	Start time
		Fan coil stage
		Set point heating
		ECO mode
	3	Start time
		Fan coil stage
		Set point heating
		ECO mode
	3	Start time
		Fan coil stage
		Set point heating
		ECO mode

A period is activated, if time and weekday are in conformance with the parameterized start time and weekday mask. A period remains active until conditions of another period are fulfilled. Active set point can be overridden over Modbus by means of holding register 255. For further information see chapter [Set point](#). Time channels are prioritized. Channel 3 has the highest priority.

Parameterization of the device is made in parameter menu or via PC configuration tool, which stores the configuration file on a SD card or transmits the parameter to the device via bus (only Modbus devices).

### 4.3.2 Menu time channel

Up to three time channels, each including 4 periods, can be parameterized. For each period start time, set point, fan coil stage and ECO-mode can be set.

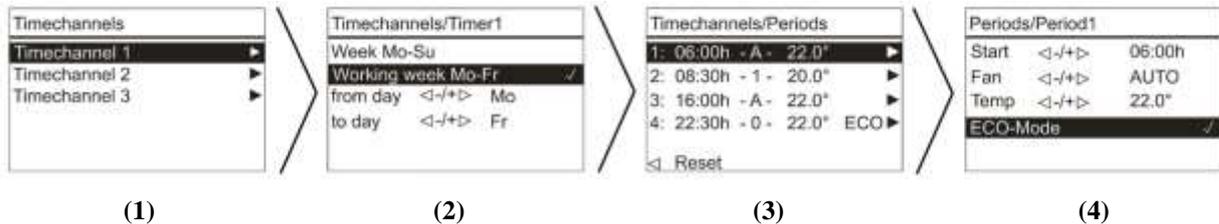

Picture 16: Menu "Selection of Time Channel"

After having selected the line of the time channel that shall be processed, next submenu "Weekday Mask" is invoked actuating key RIGHT. In the first two lines the complete week from Monday to Friday or the working week from Monday to Friday is chosen. Alternatively, any period within a week can be adjusted in lines 3 and 4. The selected time period is marked with symbol ✓.

In the lower line menu "Selection of Periods" can be invoked (key RIGHT). Here an overview of all 4 periods of the corresponding time channel is shown first. The adjusted parameters of the corresponding period are displayed in shortened form in the following sequence from left to right.

Index time period / start time / fan coil stage / set point/ info ECO-Mode

After selection of the period that shall be processed, the corresponding submenu can be invoked by key RIGHT. In the lowest line the adjustments of the time channel can be reset (key LEFT). ATTENTION: A reset deletes all settings and cannot be cancelled anymore!

To return to the corresponding previous menu the cursor must be on the top line. Afterwards, the key LEFT must be actuated. **Changes of the time channel are stored by return from menu (2) to menu (1) actuating key LEFT.**

### 4.3.3 Holding register

#### Start

The start time can be changed in 15 minutes step.

#### Fan

*3 stages fan coil type (3 relays)*

Fan coil stage selection between OFF, Stage 1, Stage 2, Stage 3 and AUTOMATIC.

*EC fan coil type (0-10V)*

Fan coil selection between OFF and AUTOMATIC

#### Set Point

The set point can be adjusted in the range 0°C to 50°C.

#### ECO-Mode

In addition, ECO mode can be set (key ENTER). In ECO mode, the dead zone between heating and cooling is set automatically to the configured ECO dead band (standard 10K). Also the pulse-width-modulation cycle time is doubled. If a period with ECO Mode is activated, the ECO symbol is faded-in at the main screen.

Modbus Holding Register (R/W)	
Register Data Address	Description
34	(#) Time channel 1 weekdays  Display process value: 0x0F <sub>hex</sub> = Monday, Tuesday, Wednesday, Thursday  Default: 0x00 <sub>hex</sub>  Adjustable range 0x00 <sub>hex</sub> -0x7F <sub>hex</sub>  Bit0: Monday Bit1: Tuesday Bit2: Wednesday Bit3: Thursday Bit4: Friday Bit5: Saturday Bit6: Sunday
35	(#)Time channel 1 period 1: Start time hour Display process value: 0x0D <sub>hex</sub> = 13h  Default: 0h  Adjustable range: 0 – 23h
36	(#)Time channel 1 period 1: Start time minute  Display process value: 0x3B <sub>hex</sub> = 59m  Default: 0m  Adjustable range: 0 – 59m
37	(#)Time channel 1 period 1: Set point  Display process value: 21,0°C = 0x15 <sub>hex</sub>  Default: 0,0°C  Adjustable range: 0,0 – 50,0°C
3 stages fan coil type (3 relays)	

38	<p>(#)Time channel 1 period 1: Fan coil stage</p> <p>Display process value : 0x04<sub>hex</sub> = Automatic</p> <p>Default: 0x00<sub>hex</sub>: Off</p> <p>Value range: 0x00<sub>hex</sub>: Off 0x01<sub>hex</sub>: Stage 1 0x02<sub>hex</sub>: Stage 2 0x03<sub>hex</sub>: Stage 3 0x04<sub>hex</sub>: Automatic</p>
<i>EC-fan coil type (0-10V)</i>	
38	<p>(#)Time channel 1 period 1: Fan coil stage</p> <p>Display process value : 0x01<sub>hex</sub> = Automatic</p> <p>Default: 0x00<sub>hex</sub>: Off</p> <p>Value range: 0x00<sub>hex</sub>: Off 0x01<sub>hex</sub>: Automatic</p>
39	<p>(#)Time channel 1 period 1: ECO mode</p> <p>Display process value 0x01<sub>hex</sub> = ECO Mode active</p> <p>Default: 0x00<sub>hex</sub>: ECO Mode off</p> <p>Value range: 0x00<sub>hex</sub>: ECO Mode off 0x01<sub>hex</sub>: ECO Mode active</p>
40-44	(#) Time channel 1 period 2
45-49	(#) Time channel 1 period 3
55-75	(#) Time channel 2
76-96	(#) Time channel 3

**The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!**

The segments of time channels 2 and 3 are following with corresponding register offsets. A complete register list can be found in chapter **Modbus Register Reference**.

## 4.4 Temperature

### 4.4.1 Overview

JOY has an integrated temperature sensor. By default this value is used as actual value for the internal controller. As described in chapter **Inputs** the universal input can be parameterized as a sensor input for an external sensor. In this case, the external sensor value is used as actual value and additionally is indicated as temperature display. Measurement range of the sensor is ranging from 0...50°C with a resolution of 0,1°. For both sensors a calibration to compensate self-heating is possible.

### 4.4.2 Holding Register

Modbus Holding Register (R/W)	
Register Data Address	Description
4	(#) Offset internal sensor  Display process value: 1,0°C = 10 <sub>dez</sub>  Default: 0,0°C  Adjustable range 0,0 - 15,0°C
5	(#) Offset external sensor  Display process value: 1,0°C = 10 <sub>dez</sub>  Default: 0,0°C  Adjustable range 0,0 - 15,0°C
6	(#) Unit temperature  Default: 0x01 <sub>hex</sub> : °Celsius  Value range: 0x00 <sub>hex</sub> : not implemented 0x01 <sub>hex</sub> : °Celsius 0x02 <sub>hex</sub> : °Fahrenheit

The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime !

### 4.4.3 Input Register

Modbus Input Register (R)	
Register Data Address	Description
514	Internal temperature sensor Display process value: 21,5°C = 215 <sub>dez</sub>
515	External temperature sensor Display process value: 21,5°C = 215 <sub>dez</sub>

## 4.5 Inputs

### 4.5.1 Overview

Two digital inputs are available at Modbus type, whereas input 1 is a potential-free universal input and input 2 is a 230V input. The 3DI type has an additional potential-free input. Depending on the selected input different functions such as window contact, dew point contact, occupancy contact, change-over contact, keycard switch and external temperature sensor can be configured which are briefly explained in the following chapters. For every input, polarity can be configured in addition (make contact/break contact).

The internal input state is linked by an OR-function with the corresponding Modbus register when being configured as window or dew point contact. As for occupancy or change-over configuration the corresponding Modbus register overrides the internal state.

Table 2: Overview of possible combinations

Input 230V (Input 2)	Input 3DI (Input 3) (not available with Modbus device)	Input Universal (Input 1)
Change-Over DI	Window contact	Sensor (NTC10k)
		Window contact
		Dew point contact
		Occupancy contact
		Keycard switch
	Dew point contact	Sensor (NTC10k)
		Window contact
		Dew point contact
		Occupancy contact
		Keycard Switch
	Occupancy contact	Sensor (NTC10k)
		Window contact
		Dew point contact
		Keycard Switch
	Keycard Switch	Sensor (NTC10k)
		Window contact
Dew point contact		
Occupancy contact		
Not used	Change-Over DI	Sensor (NTC10k)
		Window contact
		Dew point contact
		Occupancy contact
		Keycard Switch
	Window contact	Sensor (NTC10k)
		Change-Over DI
		Change-Over Sensor (NTC10k)
		Window contact
		Dew point contact
		Occupancy contact
		Keycard Switch
	Dew point contact	Sensor (NTC10k)
		Change-Over DI
		Change-Over Sensor (NTC10k)
		Window contact
		Dew point contact
		Occupancy contact
		Keycard Switch
	Occupancy contact	Sensor (NTC10k)
Change-Over DI		
Change-Over Sensor (NTC10k)		
Window contact		
Dew point contact		
Keycard Switch		
Keycard Switch	Sensor	
	Change-Over DI	
	Change-Over Sensor (NTC10k)	
	Window contact	
	Dew point contact	
	Occupancy contact	

## 4.5.2 Configurabe Functions

### 4.5.2.1 External Temperature Sensor (NTC10k)

At universal input 1 an external temperature sensor of type NTC10k can be connected. If configured the external sensor value is automatically used as actual value for the internal controller and is shown in display.

### 4.5.2.2 Change-Over Digital Contact

The input is used as a digital change-over-default for the controller. At maximum one input can be configured as a change-over contact! For further information see chapter [Change-Over](#).

### 4.5.2.3 Change-Over Sensor(NTC10k)

An external temperature sensor of type NTC10k can be connected at the universal input. With this configuration the measured temperature-value determines the change-over-default to the controller. At maximum one input can be configured as a change-over contact! Read more in chapter [Change-Over](#).

### 4.5.2.4 Window Contact

Universal input can be configured as window contact. They are linked by an OR-function. Further information in chapter [Window Contact/Energy Lock](#).

### 4.5.2.5 Dewpoint Contact

Universal input can be configured as dewpoint contact. They are linked by an OR-function. Read more in chapter [Dewpoint](#).

### 4.5.2.6 Occupancy Contact

The input is used as a occupancy contact. At maximum one input can be used as an occupancy contact. Further information to be obtained in chapter [Occupancy](#).

### 4.5.2.7 Keycard Switch

Input will be used as keycard detection. Further information to be obtained in chapter [Keycard Switch](#).

### 4.5.3 Holding Register

Modbus Holding Register	
Register Data Address	Description
18	(#) Input 1: Universal input  Default: 0x00 <sub>hex</sub> : Not used  Value range: 0x00 <sub>hex</sub> : Not used 0x01 <sub>hex</sub> : External temperature sensor (NTC10k) 0x02 <sub>hex</sub> : Change-over sensor (NTC10k) 0x03 <sub>hex</sub> : Change-over make contact (NO = normally open) 0x04 <sub>hex</sub> : Window contact make contact 0x05 <sub>hex</sub> : Occupancy make contact 0x06 <sub>hex</sub> : Dew point make contact ( 0x07 <sub>hex</sub> : Change-over break contact (NC = normally closed) 0x08 <sub>hex</sub> : Window contact break contact 0x09 <sub>hex</sub> : Occupancy break contact 0x0A <sub>hex</sub> : Dew point break contact 0x0B <sub>hex</sub> : Keycard switch make contact 0x0C <sub>hex</sub> : Keycard switch break contact
19	(#) Input 2: 230V  Default: 0x00 <sub>hex</sub> : Not used  Value range: 0x00 <sub>hex</sub> : Not used 0x03 <sub>hex</sub> : Change-over make contact (NO = normally open) 0x07 <sub>hex</sub> : Change-over break contact (NC = normally closed)


**The registers marked with # are saved in EEPROM. They shall be written only during configuration and not at runtime!**

#### 4.5.4 Input Register

Modbus Input Register (R)	
Register Data Address	Description
519	State input 1: Universal  Display process value: 0x00 <sub>hex</sub> = Open  Value range: 0x00 <sub>hex</sub> : Open 0x01 <sub>hex</sub> : Closed
520	State input 2: 230V  Display process value: 0x00 <sub>hex</sub> = Open  Value range: 0x00 <sub>hex</sub> : Open 0x01 <sub>hex</sub> : Closed

#### 4.6 Alarm

It's possible to fade-in an alarm symbol in the header line of the display. This symbol is at the same position as the ECO symbol. As the alarm symbol has a higher priority, the ECO symbol is overridden. If an alarm is active, the background illumination of the LCD is blinking.



Picture 17: Header with faded-in alarm symbol

#### 4.6.1 Holding Register

Modbus Holding Register (R/W)	
Register Data-Address	Description
263	Default alarm  Default: 0x00 <sub>hex</sub> : No alarm  Value range: 0x00 <sub>hex</sub> : No alarm 0x01 <sub>hex</sub> : Alarm

## 4.7 Set point

### 4.7.1 Overview

The active set point is determined by configuration of the time channels. The user can modify values in defined limits.

The Modbus type enables the option to configure the set point according to your needs and/or to indicate the set point from a supervisory system at runtime.

### 4.7.2 Holding Register

#### Set point after reset

(Parameter)

After a restart of the device this value is used as a set point until a new set point or a Modbus default is activated.

#### Adjustment range of set point

(Parameter)

Determines the limits of the set point adjustment range. When selecting the display of the set point adjustment (register 113) as stage display – 3...+3 this parameter must be set to the value of the set point offset of stage 3!

Example: Step size 1K => Stage 3 is equivalent to 3K => enter this value!! Take care of the scaling!

#### Set point step range

(Parameter)

Determines the step size of the set point offset upon changes at the device by a user.

#### Dead band/Dead band ECO-mode

(Parameter)

Determines the deadband in normal controller mode respectively in ECO-mode. For activation of the ECO-mode refer to chapter [Time Channels](#).

#### Set point adjustment standby

(Parameter)

When using the occupancy function by a digital input or via Modbus, the configured value is automatically deducted from the heating set point or added to the cooling set point in UNOCCUPIED state.

#### Frost Protection/Heating Protection

(Parameter)

By use of the window function (energy lock) through a digital input or via Modbus, in case "Window open/Energy lock active" the heating and cooling set points are set to the configured values.

#### Basic Set point

This register is designed for the set point default by a supervisory system. Heating and cooling set point are calculated internally out of this value and the dead band depending on the mode (normal/ECO).

#### Set point Offset

External default for override of internal set point offset.

Modbus Holding Register (R/W)	
Register Data Address	Description
20	(#) Set point after reset  Display process value: 21,5°C = 215 <sub>dez</sub>  Default: 21,0°C  Adjustable range: 0,0 - 50,0°C
21	(#) Adjustable range set point  Display process value: 3,0°C = 30 <sub>dez</sub>  Default: 3,0°C  Adjustable range: 0,0 - 10,0°C
22	(#) Set point step range  Display process value: 0,5°C = 5 <sub>dez</sub>  Default: 0,5°C  Adjustable range 0,0 - 10,0°C
23	(#) Dead band  Display process value: 1,0°C = 10 <sub>dez</sub>  Default: 2,0°C  Adjustable range 0,0 - 15,0°C

24	<p>(#) Dead band ECO mode</p> <p>Display process value: 10,0°C = 100<sub>dez</sub></p> <p>Default: 10,0°C</p> <p>Adjustable range: 0,0 - 15,0°C</p>
25	<p>(#) Set point adjustment standby</p> <p>Display process value: 2,0°C = 20<sub>dez</sub></p> <p>Default: 2,0°C</p> <p>Adjustable range: 0,0 - 15,0°C</p>
26	<p>(#) Frost Protection</p> <p>Display process value: 7,0°C = 70<sub>dez</sub></p> <p>Default: 7,0°C</p> <p>Adjustable range: 0,0 - 15,0°C</p>
27	<p>(#) Heat protection</p> <p>Display process value: 35,0°C = 350<sub>dez</sub></p> <p>Default: 35,0°C</p> <p>Adjustable range: 0,0 - 50,0°C</p>
255	<p>Basic set point</p> <p>Display process value: 21,0°C = 210<sub>dez</sub></p> <p>Default: 21,0°C</p> <p>Adjustable range: 0,0 - 50,0°C</p>

256	Set point offset  Display process value: $1,0^{\circ}\text{C} = 10_{\text{dez}}$  Default: $0,0^{\circ}\text{C}$  Adjustable range: $0,0 - 15,0^{\circ}\text{C}$
-----	---

The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!

### 4.7.3 Input Register

#### Set point heating

Output of active heating set point which depends on the default of basic set point (time channel/Modbus default), set point offset (user/Modbus) and mode (normal/ECO, occupied/unoccupied).

The value changed at last determines the set point, i.e. set point of the active time channel will be overwritten by an update of Modbus register 256 or if a new time channel is activated.

#### Set point cooling

Output of the active cooling which depends on the default of basic set point (time channel/Modbus default), set point offset (user/Modbus) and mode (normal/ECO, occupied/unoccupied).

The value changed at last determines the set point, i.e. set point of the active time channel will be overwritten by an update of Modbus register 256 or if a new time channel is activated.

#### Set point offset

Output of internal offset which is defined by user setting at JOY or via Modbus register 257. The value changed at last determines the set point. This means for example that a set point adjusted by user will be overwritten with the next update by Modbus register 257.

Modbus Input Register (R)	
Register Data Address	Description
511	Set point heating  Display process value: $21,5^{\circ}\text{C} = 215_{\text{dez}}$
512	Set point cooling  Display process value: $21,5^{\circ}\text{C} = 215_{\text{dez}}$
513	Set point offset  Display process value: $0,5^{\circ}\text{C} = 5_{\text{dez}}$

## 4.8 Fan coil stages

### 4.8.1 3 stages fan coil type (3 relays)

#### 4.8.1.1 Overview

JOY comes with three outputs for control of up to three fan coil stages. Fan coil stage can be changed manually. The number of existing stages can be configured. The user can select between OFF, STAGE1, STAGE2, STAGE3 and AUTOMATIC operation. In automatic mode the fan coil stage is linked to the controller. The fan coil can be freely assigned to controller mode (enabled at (a) heating/cooling, (b) only heating or (c) only cooling).

To guarantee a save start-up of the fan, a period of time can be parameterized in which the fan starts with the highest possible stage available.

The function of the fan coil stage is determined during configuration of the time channels (see chapter **time channels**) per period. The user is able to override the time channel settings by manual operation. With start of the next time channel period the fan coil stage is set to the value configured in the period. In addition it is possible to override the stage via Modbus. With start of next time channel period the fan coil stage is set to the value configured in the period.

When using the option occupancy the fan stage is linked with occupancy state. In manual mode, fan is switched to automatic mode if occupancy state changes to UNOCCUPIED. Then, set points of state UNOCCUPIED are valid. When returning to state OCCUPIED automatic mode is set, activating set point values of state OCCUPIED.

#### 4.8.1.2 Holding Register

##### Threshold stage 1/2/3

The value configured determines the threshold between set and actual value at which the individual fan stages are switched on when controller is active. For example using the default setting (threshold value fan stage 1 = 0), fan stage 1 is started instantly if a control deviation occurs. It has to be considered that a hysteresis for the switching- on and off of the fan stages is activated (+/-0.3°C) to prevent a flickering of the outputs!

##### Start-up time fan coil

To guarantee a save start-up of the fan, a period of time can be configured in which the fan starts with the highest possible stage available.

##### Fan coil assignment

Optionally, the fan can optionally be allocated to heating or cooling controller or to both at the same time.

Modbus Holding Register (R/W)	
Register Data Address	Description
9	(#)Number of fan coil stages  Default: 0x03 <sub>hex</sub> : Stage 3  Value range: 0x01 <sub>hex</sub> : 1 stage 0x02 <sub>hex</sub> : 2 stage 0x03 <sub>hex</sub> : 3 stage
30	(#) Treshold stage 1 ON  Display process value: 1,0°C = 10 <sub>dez</sub>  Default: 0,0°C  Adjustable range 0,0 - 15,0°C
31	(#) Treshold stage 2 ON  Display process value: 1,5°C = 15 <sub>dez</sub>  Default: 1,5°C  Adjustable range 0,0 - 15,0°C
32	(#) Treshold stage 3 ON  Display process value: 3,0°C = 30 <sub>dez</sub>  Default: 3,0°C  Adjustable range 0,0 - 15,0°C
98	(#)Fan coil assignment  Default: 0x00 <sub>hex</sub> : Heating/Cooling  Value range: 0x00 <sub>hex</sub> : Heating/Cooling 0x01 <sub>hex</sub> : Heating 0x02 <sub>hex</sub> : Cooling

113	(#) Start-up time fan coil  Default: 0x0A <sub>hex</sub> = 10 = 1s  Value range: 0x00 <sub>hex</sub> – 0x12C <sub>hex</sub> = 0 – 300 = 0 – 30s
270	Fan coil stage  Default: 0x04 <sub>hex</sub> : Automatic  Value range: 0x00 <sub>hex</sub> : Off 0x01 <sub>hex</sub> : Stage 1 0x02 <sub>hex</sub> : Stage 2 0x03 <sub>hex</sub> : Stage 3 0x03 <sub>hex</sub> : Automatic

The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!

#### 4.8.1.3 Input Register

Modbus Input Register (R)	
Register Data Address	Description
518	State fan coil stage  Default: 0xFFFF <sub>hex</sub> : Off  Value range: 0x00 <sub>hex</sub> : Off 0x01 <sub>hex</sub> : Stage 1 0x02 <sub>hex</sub> : Stage 2 0x03 <sub>hex</sub> : Stage 3

## 4.8.2 EC-fan coil (0-10V)

### 4.8.2.1 Overview

A 0-10V output is implemented for control of an EC fan. The speed of the fan coil unit can be changed manually via the keys. The number of steps for changing the speed between 0 and 100% is configurable. In automatic mode the fan coil stage is linked to the controller. The fan coil can be freely assigned to controller mode (enabled at (a) heating/cooling, (b) only heating or (c) only cooling).

When using a PI controller, the output value corresponds to the control variable of the controller, adapted to the number of stages of the fan control. With a 2-point controller the output value is also adapted to the number of stages of the fan control depending on the parameter "deviation temperature for maximum fan stage control".

To guarantee a reliable start-up of the fan coil unit, a period of time can be parameterized in which the fan starts with the highest possible stage available.

If time channels are used, the operation mode of fan coil unit is determined during configuration of the time channels (see chapter **time channels**) per period. The user is able to override the time channel settings by manual operation. With start of the next time channel period the fan coil stage is set to the value configured in the period.

In addition, fan coil stage can be overridden via Modbus. With start of next time channel period the fan coil stage is set to the value configured in corresponding period.

When using the option occupancy the fan stage is linked with occupancy state. In manual mode, fan is switched to automatic mode if occupancy state changes to UNOCCUPIED. Then, set points of state UNOCCUPIED are valid. When returning to state OCCUPIED automatic mode is set, activating set point values of state OCCUPIED.

The parameter *fan coil minimum* and *fan coil maximum* enable the option to adapt the fan speed individually to the control signal of the controller (0-100%), e.g. 20%-80% fan speed.

### 4.8.2.2 Holding Register

#### Maximum fan coil value (100%) at temperature deviation

If a two-point controller is activated the parameterized value is the deviation of set point from actual value at which the output of the fan coil unit has reached 100%. Below this value the output value is calculated linear to the deviation and is output in the configured stages.

#### Fan coil assignment

Optionally, the fan can only be allocated to the heating/cooling controller or to both at the same time.

#### Steps fan coil control

Determines the number of steps and thus the step size of the fan stage control.

## Description of Thermostat JOY

### Fan coil minimum, Fan coil maximum

Minimum and maximum output value for fan control. The calculation of the stages is made between minimum and maximal value.

Special case:

When setting the most significant bit of the minimum value, the minimum value corresponds to stage 1. The step size of the control is calculated of the number of stages of the fan coil unit, the minimum and maximum.

Example:

- Number of steps: 3
- Minimum: 50%, Maximum:70%
- ⇒ OFF=0%, Stage1=50%, Stage2=60%, Stage3= 70%

### Start-up-time fan coil

To guarantee a reliable start-up of the fan, a period of time can be parameterized in which the fan starts with the highest possible stage available.

### Default fan coil

Default of fan speed in percentage or toggling in automatic mode. It is converted corresponding to the parameter *steps fan coil control* to the matching step.

Example: Default: 65%, 3 fan coil stages at 33%, 66% and 100%=> Output 66%

Modbus Holding Register (R/W)	
Register Data Address	Description
30	(#)Maximum fan coil value (100%) at temperature deviation  Display process value: 1,0°C = 10 <sub>dez</sub>  Default: 4,0°C  Adjustable range: 0,0 - 15,0°C
98	(#)Fan coil assignment  Default: 0x00 <sub>hex</sub> : heating/cooling  Value range: 0x00 <sub>hex</sub> : heating/cooling 0x01 <sub>hex</sub> : heating 0x02 <sub>hex</sub> : cooling

110	<p>(#)Steps fan coil control</p> <p>Default: 0x05<sub>hex</sub> – 5 steps = 20% steps</p> <p>Value range: 0x01<sub>hex</sub> – 1 = 100% step 0x02<sub>hex</sub> – 2 = 50% steps 0x03<sub>hex</sub> – 2 = 33% steps 0x04<sub>hex</sub> – 4 = 25% steps 0x05<sub>hex</sub> – 5 = 20% steps</p>
111	<p>(#)Fan coil minimum</p> <p>Default: 0x0<sub>hex</sub> = 0% = 0V</p> <p>Value range: 0x00<sub>hex</sub> – 0x64<sub>hex</sub> = 0-100% (0-10V) Special case 0x8xxx<sub>hex</sub>, see <b>description: Fan coil minimum, Fan coil maximum</b></p>
112	<p>(#)Fan coil maximum</p> <p>Default: 0x64<sub>hex</sub> = 100% = 10V</p> <p>Value range: 0x00<sub>hex</sub> – 0x64<sub>hex</sub> = 0-100% (0-10V)</p>
113	<p>(#) Startup time fan coil</p> <p>Default: 0x0A<sub>hex</sub> = 10 = 1s</p> <p>Value range: 0x00<sub>hex</sub> – 0x12C<sub>hex</sub> = 0 – 300 = 0 – 30s</p>
270	<p>Default fan coil</p> <p>0x0<sub>hex</sub> = 0% = 0V</p> <p>Value range: 0x00<sub>hex</sub> – 0x64<sub>hex</sub> = 0-100% MANUAL 0xFF00<sub>hex</sub> = -256 = AUTOMATIC</p>

The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!

### 4.8.2.3 Input Register

Modbus Input Register (R)	
Register Data Address	Description
518	Fan coil value  Value range: 0x00 <sub>hex</sub> – 0x64 <sub>hex</sub> = 0-100% fan coil value, fan coil mode=MANUAL 0xFFx <sub>hex</sub> : fan coil value with fan coil mode=AUTOMATIC

## 4.9 Keycard Switch

If Keycard is not inserted the device is set into the ECO-mode. The operation of the keys is locked, display is switched-off and controller uses set points defaults of “room unoccupied”-state (lowering set point heating by value of register 25 *Set point adjustment standby* and increase set point cooling accordingly). If a key-card switch is parameterized, function “switch device on/off” via keys or Modbus is locked.

## 4.10 Occupancy

### 4.10.1 Overview

JOY has an occupancy function which has, if activated, a direct effect on the set point default of the controller.

The occupancy function is activated via configuration of a digital input. Further information can be obtained in the chapter **Inputs**. In case of activated occupancy function the symbol for occupancy is faded-in automatically. In addition it is possible to override the occupancy state via Modbus by a supervisory system. The default via Modbus has a higher priority than the internal state! Furthermore the ON-/OFF-key can be configured as an occupancy key (see register data address 115, ‘Special function of keys’). A short key press will set a new occupancy state.

In state “room unoccupied” the heating set point is reduced by value register 25 *Set point adjustment standby*, the cooling set point is increased accordingly.

### 4.10.2 Holding Register

#### Default Occupancy

The symbol Occupied/Unoccupied is faded-in in display automatically if value “room occupied” or “room unoccupied” is written in register 257 and the occupancy symbol is allocated to any position in the footer.

Modbus Holding Register (R/W)	
Register Data Address	Description
257	Default Occupancy  Default: 0xFFFF <sub>hex</sub> : No function  Value range: 0x00 <sub>hex</sub> : Room unoccupied 0x01 <sub>hex</sub> : Room occupied 0xFFFF <sub>hex</sub> : No function

### 4.10.3 Input Register

Modbus Input Register (R)	
Register Data Address	Description
521	Occupancy state  Default: 0xFFFF <sub>hex</sub> : No function  Value range: 0x00 <sub>hex</sub> : Room unoccupied 0x01 <sub>hex</sub> : Room occupied 0xFFFF <sub>hex</sub> : No function

## 4.11 Dewpoint

### 4.11.1 Overview

JOY implements a dewpoint function which has direct effect on the set point default of the controller if activated. An active dewpoint contact locks the cooling controller.

The dew point function is activated via one digital input or via Modbus. The default via Modbus is linked by an OR-function to internal state.

Detailed information to be found in chapter **Inputs**. With activated dewpoint function the dew point symbol “dewpoint active” is faded-in automatically and cooling controller is locked.

### 4.11.2 Holding Register

Modbus Holding Register (R/W)	
Register Data Address	Description
257	Default dewpoint  Default: 0xFFFF <sub>hex</sub> : No function  Value range: 0x00 <sub>hex</sub> : Dewpoint inactive 0x01 <sub>hex</sub> : Dewpoint active 0xFFFF <sub>hex</sub> : No function

### 4.11.3 Input Register

Modbus Input Register (R)	
Register Data Address	Description
522	State dewpoint  Default: 0xFFFF <sub>hex</sub> : No function  Value range: 0x00 <sub>hex</sub> : Dewpoint inactive 0x01 <sub>hex</sub> : Dewpoint active 0xFFFF <sub>hex</sub> : No function

## 4.12 Window Contact/Energy Lock

### 4.12.1 Overview

JOY comes with a window contact/ energy lock function which has direct effect on the set point of the controller if activated. With activated contact (window open = energy lock active) the set points for heating and cooling are automatically set to frost respectively heat protection. The window contact/energy lock function is activated via configuration of one digital input or via Modbus. The default via Modbus is linked by an OR-function to internal state.

More information to be obtained in chapter [Inputs](#). With activated window contact function (window is open) the symbol “window contact“ is faded-in automatically. Additionally frost- and heat protection are activated.

#### 4.12.2 Holding Register

Modbus Holding Register (R/W)	
Register Data Address	Description
259	Default window contact/ energy lock  Default: 0xFFFF <sub>hex</sub> : No function  Value range: 0x00 <sub>hex</sub> : Window closed 0x01 <sub>hex</sub> : Window opened 0xFFFF <sub>hex</sub> : No function

#### 4.12.3 Input Register

Modbus Input Register (R)	
Register Data Address	Description
523	State window contact/energy lock  Default: 0xFFFF <sub>hex</sub> : No function  Value range: 0x00 <sub>hex</sub> : Window closed 0x01 <sub>hex</sub> : Window opened 0xFFFF <sub>hex</sub> : no function

## 4.13 Change-Over

### 4.13.1 Overview

The room thermostat has a change-over function which has, if activated, a direct effect on controller behaviour. Via a change-over contact the mode heating or cooling is pre-defined with a 2-pipe system. The change-over function is activated via configuration of a digital input or via Modbus. An input activated as a change-over contact deactivates Modbus value (register 256). Detailed information can be obtained in chapter **Inputs**. Depending on the state of the contact, only the heating or only the cooling controller is activated.

**Note:** Only output heating (clamp 5) is active, when using change-over.

### 4.13.2 Holding Register

Modbus Holding Register (R/W)	
Register Data Address	Description
260	Default change-over  Default: 0xFFFF <sub>hex</sub> : No function  Value change: 0x00 <sub>hex</sub> : Mode heating 0x01 <sub>hex</sub> : Mode cooling 0xFFFF <sub>hex</sub> : No function


## 4.14 Controller

### 4.14.1 Overview

JOY comes with a PI- respectively two-point/three-point controller for heating and cooling. Heating and cooling can be separately configured. It can be defined which controller type shall be used and which controller shall be activated.

Besides the activation of automatic modes, heating and cooling, output can be switched manually writing to register 269. In this case internal controller is deactivated, but the corresponding symbol is faded-in on screen.

In automatic operation the fan coil stages are linked with the controller. Further information to be found in chapter [fan coil stages](#).

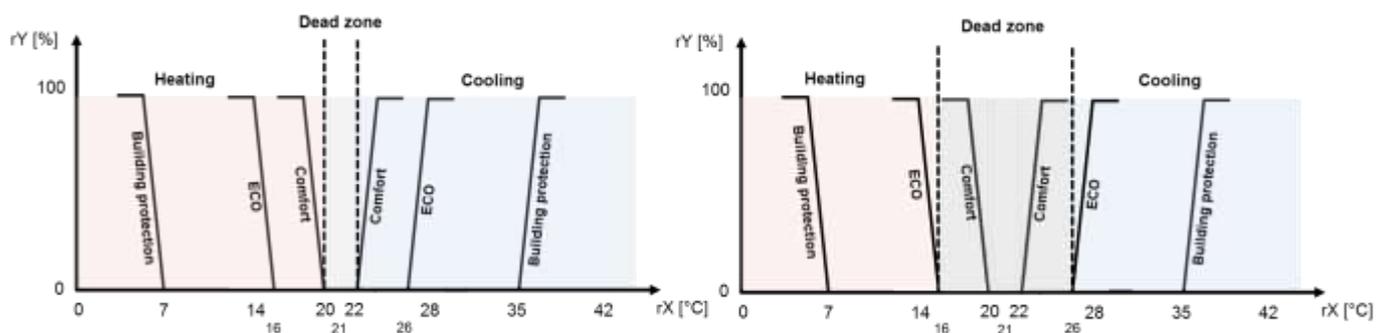

Picture 18: Two-step control with hysteresis

The set point defaults are made by the active time channel or a Modbus default and in addition to the dependence of ambient parameters such as occupancy, window contact, dew point, ECO mode and the user-defined set point offset.

Controller starts with a 4 minute delay after power-up.

### 4.14.2 PI-controller

The time response of the PI-controller is determined with parameters  $X_p$  and  $T_n$ . Due to the proportional band, the control variable reacts instantly on the control difference while the integral portion is only occurring with the time of action. The resulting control variable is output as a pulse width modulated signal.

### 4.14.3 Two-point controller

If value goes below set point less hysteresis threshold, the controller switches-on the heating output. In case value exceeds set point plus hysteresis threshold, the controller switches-off the heating output. As for cooling, it acts accordingly.

### 4.14.4 Valve Protection Function

In order to guarantee that the valves are also fully functional when not in use for a longer period of time, the room thermostat has a valve protection function. The valve protection is only started, when corresponding valve (heating or cooling) has not been triggered for more than 96 hours. The time is fixed to Friday at 11:00am (heating valve) and 11:15am (cooling valve). The corresponding valve is switched on for 5 minutes.

The valve protection function can be disabled.

#### 4.14.5 Holding Register

##### **Controller Hysteresis**

Determines the turn ON/OFF behaviour of the controller. The heating controller is switched ON if value falls below set point less half of the hysteresis and heats until actual value of set point plus half of hysteresis is exceeded. The hysteresis prevents the “flickering” of the actuator if actual value is within the value of set point.

Not used with PI-controller

##### **Controller Mode after device reset**

Determines the startup mode of controller after restart.

##### **Threshold Value Fan coil stage 1/2/3 One**

The parameterized value determines the threshold between the set point and the actual value at which the single fan coil stages are turned on. For example, fan coil stage 1 starts directly with the occurrence of a controller request at parameterized threshold = 0,0°C. Please note that there is an internal hysteresis of +/- 0.3°C active to avoid flickering of the outputs!

This parameter is only relevant if a two-point controller is used.

##### **Valve Protection Release**

Release/Lock of the valve protection

##### **Proportional band Xp**

The proportional band determines the deviation at which the controller outputs the maximum control variable (100%). A small Xp relates to a stronger controller intervention of the proportional band with lower deviations, but increases the tendency to oscillate.

##### **Reset time Tn**

Time passing by until the Integral-part produces the same control amplitude as produced directly in case of the Proportional band. To increase the integral part of the controller the reset time must be reduced.

##### **Minimum actuating variable**


Minimum value in percent.

##### **Maximum actuating variable**

Maximum value in percent.


**Mode Selection Control Variable**

- (1) Mode selection Control Variable = 1  
Ymin = 20%

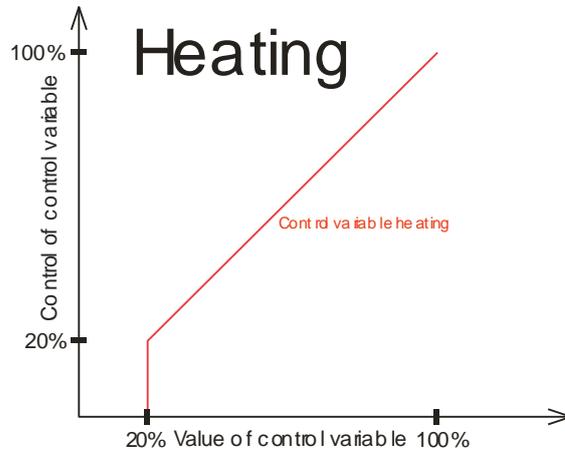

The control variable is only sent to the output if the calculated value of the control variable is bigger than the minimal control variable.

- (2) Mode selection Control Variable = 0  
Ymin = 20%

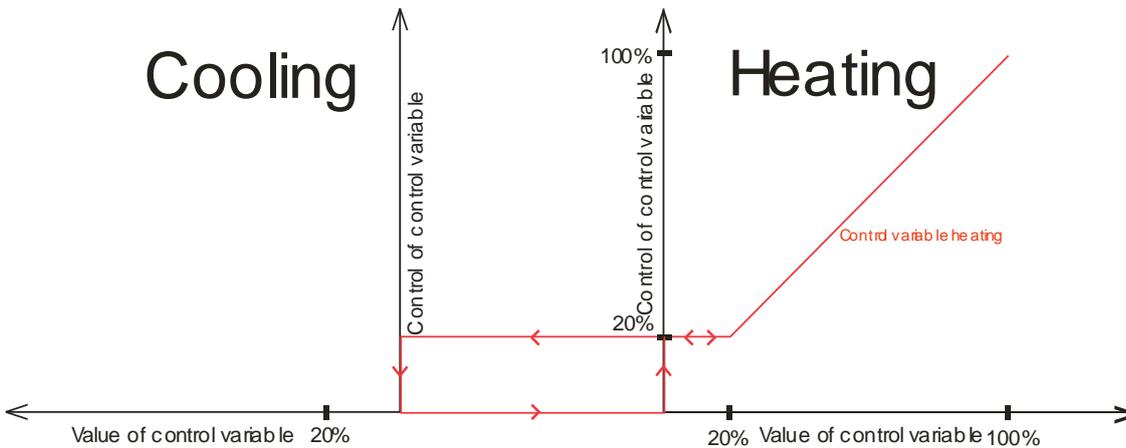

The minimal control variable at the output remains unchanged until the controller changes the operating mode

**PWM cycle time**

Cycle time of the PI-controller output signal.  
Only relevant when using the PI-controller.

**Heating controller type**

Heating controller can be configured as PI- or Two-point-controller.

**Cooling controller type**

Cooling controller can be configured as PI- or Two-point-controller.

### Default Controller Mode

Default of controller mode. In automatic operation the controller controls to heating and cooling set point. 'Heating mode enabled' means that controller is in automatic heating mode with deactivated cooling controller and vice versa. Additionally it is possible to set heating and cooling output manually. If one of the outputs is set to manual mode the corresponding symbol in display is faded-in. Internal controller is deactivated.

Modbus Holding Register (R/W)	
Register Data Address	Description
28	(#) Controller hysteresis  Display process value: $1,0^{\circ}\text{C} = 10_{\text{dez}}$  Default: $1,0^{\circ}\text{C}$  Adjustable range: $0,0 - 15,0^{\circ}\text{C}$
29	(#) Controller Mode after device reset  Default: $0x03_{\text{hex}}$ : Automatic  Value range: $0x00_{\text{hex}}$ : Off $0x01_{\text{hex}}$ : Heating $0x02_{\text{hex}}$ : Cooling $0x03_{\text{hex}}$ : Auto $0x11_{\text{hex}}$ : Heating mode (auto) triggering heat and cool relay/output $0x12_{\text{hex}}$ : Cooling mode (auto) triggering heat and cool relay/output
33	(#) Valve protection release  Default: $0x01_{\text{hex}}$ : Release  Value range: $0x00_{\text{hex}}$ : Lock $0x01_{\text{hex}}$ : Release
102	(#) Proportional band Xp  Display process value: $1,5^{\circ}\text{C} = 15_{\text{dez}}$  Default: $2^{\circ}\text{C}$  Adjustable range: $0,0 - 10,0^{\circ}\text{C}$

103	<p>(#) Reset time Tn</p> <p>Display process value: 10min = 10<sub>dez</sub></p> <p>Default: 30min</p> <p>Adjustable range: 0 – 1000min</p>
104	<p>(#) Minimum actuating variable</p> <p>Display process value: 10% = 10<sub>dez</sub></p> <p>Default: 0%</p> <p>Adjustable range: 0 – 100%</p>
105	<p>(#) Maximum actuating variable</p> <p>Display process value: 10% = 10<sub>dez</sub></p> <p>Default: 100%</p> <p>Adjustable range: 0 – 100%</p>
106	<p>(#) Mode Selection Control Variable</p> <p>Default: 0 - Use Minimal Control Variable with control variable = 0</p> <p>Value range: 0x00 - Use Minimal Control Variable with control variable = 0 0x01 – Use Minimal Control Variable with control variable &gt; 0</p>
107	<p>(#) PWM cycle time</p> <p>Display process value: 10min = 10<sub>dez</sub></p> <p>Default: 30min</p> <p>Adjustable range: 5 – 60min</p>
108	<p>(#) Heating controller type</p> <p>Default: 0 – PI-controller</p> <p>Value range: 0x00 - PI-controller 0x01 – Two-point controller</p>

109	(#) Cooling controller type  Default: 0 – PI-controller  Value range: 0x00 - PI-controller 0x01 – Two-point controller
269	Default controller mode  Default: 0x03 <sub>hex</sub> : Auto  Value range: 0x00 <sub>hex</sub> : Off 0x01 <sub>hex</sub> : Heating mode enabled (auto) 0x02 <sub>hex</sub> : Cooling mode enabled (auto) 0x03 <sub>hex</sub> : Auto mode  0x11 <sub>hex</sub> : Heating mode (auto) triggering heat and cool relay/output 0x12 <sub>hex</sub> : Cooling mode (auto) triggering heat and cool relay/output  0xFF01 <sub>hex</sub> : Set heating output (manual mode) 0xFF02 <sub>hex</sub> : Set cooling output (manual mode) 0xFF11 <sub>hex</sub> : Heating mode (manual) triggering heat and cool relay/output 0xFF12 <sub>hex</sub> : Cooling mode (manual) triggering heat and cool relay/output

**The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!**

## 4.14.5.1 Input Register

Modbus Input Register (R)	
Register Data Address	Description
516	Output heating Value range: 0x00 <sub>hex</sub> : Off 0x01 <sub>hex</sub> : On
517	Output cooling Value range: 0x00 <sub>hex</sub> : Off 0x01 <sub>hex</sub> : On
524	Actuating variable controller Value range: 0x00 <sub>hex</sub> -0x64 <sub>hex</sub> = 0-100%
525	Controller mode feedback Value range: 0x00 <sub>hex</sub> : Off 0x01 <sub>hex</sub> : Heating 0x02 <sub>hex</sub> : Cooling

## 5 Modbus Register Reference

### 5.1 3 stages fan coil type (3 relays)

#### 5.1.1 Holding Register

Modbus Holding Register (R/W)	
Register Data Address	Description
0	(#)
1	(#)
2	(#) Device location recognition
3	(#) Language
4	(#) Offset internal sensor
5	(#) Offset external sensor
6	(#) Unit temperature
7	(#) Format time
8	(#) Format date
9	(#) Number of fan coil stages
10	(#) Display main screen
11	(#) Footer symbol 1
12	(#) Footer symbol 2
13	(#) Footer symbol 3
14	(#) Footer symbol 4
15	(#) Footer symbol 5
16	(#) Brightness background illumination LCD
17	(#) Brightness ring
18	(#) Input 1 universal input
19	(#) Input 2 230V input
20	(#) Set point after reset
21	(#) Set point adjustment
22	(#) Set point stepping
23	(#) Deadband
24	(#) Deadband ECO mode
25	(#) Set point adjustment standby
26	(#) Frost protection
27	(#) Heating protection
28	(#) Controller hysteresis
29	(#) Controller mode after device restart
30	(#) Threshold fan coil stage 1 On
31	(#) Threshold fan state 2 On
32	(#) Threshold fan coil stage 3 On
33	(#) Release valve protection
34	(#) Time channel 1 weekday
35	(#) Time channel 1 start time hour period 1
36	(#) Time channel 1 start time minute period 1
37	(#) Time channel 1 set point period 1
38	(#) Time channel 1 fan coil stage period 1
39	(#) Time channel 1 ECO mode period 1
40	(#) Time channel 1 start time hour period 2
41	(#) Time channel 1 start time minute period 2
42	(#) Time channel 1 set point period 2

**Description of Thermostat JOY**

43	(#) Time channel 1 fan coil stage period 2
44	(#) Time channel 1 ECO Mode period 1
45	(#) Time channel 1 start time hour period 3
46	(#) Time channel 1 start time minute period 3
47	(#) Time channel 1 set point period 3
48	(#) Time channel 1 fan coil stage period 3
49	(#) Time channel 1 ECO mode period 3
50	(#) Time channel 1 start time hour period 4
51	(#) Time channel 1 start time minute period 4
52	(#) Time channel 1 set point period 4
53	(#) Time channel 1 fan coil stage period 4
54	(#) Time channel 1 ECO mode period 4
55	(#) Time channel 2 weekdays
56	(#) Time channel 2 start time hour period 1
57	(#) Time channel 2 start time minute period 1
58	(#) Time channel 2 set point period 1
59	(#) Time channel 2 fan coil stage period 1
60	(#) Time channel 2 ECO mode period 1
61	(#) Time channel 2 start time hour period 2
62	(#) Time channel 2 start time minute period 2
63	(#) Time channel 2 set point period 2
64	(#) Time channel 2 fan coil stage period 2
65	(#) Time channel 2 ECO mode period 1
66	(#) Time channel 2 start time hour period 3
67	(#) Time channel 2 start time minute period 3
68	(#) Time channel 2 set point period 3
69	(#) Time channel 2 fan coil stage period 3
70	(#) Time channel 2 ECO mode period 3
71	(#) Time channel 2 start time hour period 4
72	(#) Time channel 2 start time minute period 4
73	(#) Time channel 2 set point period 4
74	(#) Time channel 2 fan coil stage period 4
75	(#) Time channel 2 ECO mode period 4
76	(#) Time channel 3 weekdays
77	(#) Time channel 3 start time hour period 1
78	(#) Time channel 3 start time minute period 1
79	(#) Time channel 3 set point period 1
80	(#) Time channel 3 fan coil stage period 1
81	(#) Time channel 3 ECO mode period 1
82	(#) Time channel 3 start time hour period 2
83	(#) Time channel 3 start time minute period 2
84	(#) Time channel 3 set point period 2
85	(#) Time channel 3 fan coil stage period 2
86	(#) Time channel 3 ECO mode period 1
87	(#) Time channel 3 start time hour period 3
88	(#) Time channel 3 start time minute period 3
89	(#) Time channel 3 set point period 3
90	(#) Time channel 3 fan coil stage period 3
91	(#) Time channel 3 ECO mode period 3
92	(#) Time channel 3 start time hour period 4
93	(#) Time channel 3 start time minute period 4
94	(#) Time channel 3 set point period 4
95	(#) Time channel 3 fan coil stage period 4
96	(#) Time channel 3 ECO mode period 4

97	(#) Daylight saving
98	(#) Fan coil assignment
99	(#) Max heating load
100	(#) Max cooling load
101	(#)
102	(#) Proportional band Xp
103	(#) Reset time Tn
104	(#) Minimum actuating variable
105	(#) Maximum actuating variable
106	(#) Mode Selection Control Variable
107	(#) PWM cycle time
108	(#) Heating controller type
109	(#) Cooling controller type
110	(#)
111	(#)
112	(#)
113	(#) Startup-time fan coil
114	(#) Display set point adjustment
115	(#) Special function key ON/OFF
116	(#) reserved
117	(#) reserved
118	(#) reserved
119	(#) reserved
120	(#) reserved
121	(#) reserved
122	(#) reserved
123	(#) reserved
<b>Register Data Address</b>	<b>Description</b>
255	Basic set point
256	Set point offset
257	Default presence
258	Default dew point
259	Default window contact/energy lock
260	Default change-over
261	Device On/Off
262	Release keys
263	Default alarm
264	Time hour
265	Time minute
266	Date day
267	Date month
268	Date year
269	Default controller
270	Fan coil stage

The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!

## 5.2 Input Register

Modbus Input Register (R)	
Register Data Address	Description
511	Set point heating
512	Set point cooling
513	Set point offset
514	Internal temperature sensor
515	External temperature sensor
516	Output heating
517	Output cooling
518	State fan coil stage
519	State input 1
520	State input 2
521	State presence
522	State dew point
523	State window contact/energy lock
524	Actuating variable controller
525	Controller mode feedback

### 5.3 EC- fan coil type (0-10V)

#### 5.3.1 Holding Register

Modbus Holding Register (R/W)	
Register Data Address	Description
0	(#)
1	(#)
2	(#) Device location recognition
3	(#) Language
4	(#) Offset internal sensor
5	(#) Offset external sensor
6	(#) Unit temperature
7	(#) Format time
8	(#) Format date
9	
10	(#) Display main screen
11	(#) Footer symbol 1
12	(#) Footer symbol 2
13	(#) Footer symbol 3
14	(#) Footer symbol 4
15	(#) Footer symbol 5
16	(#) Brightness background illumination LCD
17	(#) Brightness ring
18	(#) Input 1 universal input
19	(#) Input 2 230V input
20	(#) Set point after reset
21	(#) Set point adjustment
22	(#) Set point stepping
23	(#) Deadband
24	(#) Deadband ECO mode
25	(#) Set point adjustment standby
26	(#) Frost protection
27	(#) Heating protection
28	(#) Controller hysteresis
29	(#) Controller mode after device restart
30	(#)Maximum fan coil value (100%) at temperature deviation
31	
32	
33	(#) Release valve protection
34	(#) Time channel 1 weekday
35	(#) Time channel 1 start time hour period 1
36	(#) Time channel 1 start time minute period 1
37	(#) Time channel 1 set point period 1
38	(#) Time channel 1 fan coil stage period 1
39	(#) Time channel 1 ECO mode period 1
40	(#) Time channel 1 start time hour period 2
41	(#) Time channel 1 start time minute period 2
42	(#) Time channel 1 set point period 2
43	(#) Time channel 1 fan coil stage period 2
44	(#) Time channel 1 ECO Mode period 1

45	(#) Time channel 1 start time hour period 3
46	(#) Time channel 1 start time minute period 3
47	(#) Time channel 1 set point period 3
48	(#) Time channel 1 fan coil stage period 3
49	(#) Time channel 1 ECO mode period 3
50	(#) Time channel 1 start time hour period 4
51	(#) Time channel 1 start time minute period 4
52	(#) Time channel 1 set point period 4
53	(#) Time channel 1 fan coil stage period 4
54	(#) Time channel 1 ECO mode period 4
55	(#) Time channel 2 weekdays
56	(#) Time channel 2 start time hour period 1
57	(#) Time channel 2 start time minute period 1
58	(#) Time channel 2 set point period 1
59	(#) Time channel 2 fan coil stage period 1
60	(#) Time channel 2 ECO mode period 1
61	(#) Time channel 2 start time hour period 2
62	(#) Time channel 2 start time minute period 2
63	(#) Time channel 2 set point period 2
64	(#) Time channel 2 fan coil stage period 2
65	(#) Time channel 2 ECO mode period 1
66	(#) Time channel 2 start time hour period 3
67	(#) Time channel 2 start time minute period 3
68	(#) Time channel 2 set point period 3
69	(#) Time channel 2 fan coil stage period 3
70	(#) Time channel 2 ECO mode period 3
71	(#) Time channel 2 start time hour period 4
72	(#) Time channel 2 start time minute period 4
73	(#) Time channel 2 set point period 4
74	(#) Time channel 2 fan coil stage period 4
75	(#) Time channel 2 ECO mode period 4
76	(#) Time channel 3 weekdays
77	(#) Time channel 3 start time hour period 1
78	(#) Time channel 3 start time minute period 1
79	(#) Time channel 3 set point period 1
80	(#) Time channel 3 fan coil stage period 1
81	(#) Time channel 3 ECO mode period 1
82	(#) Time channel 3 start time hour period 2
83	(#) Time channel 3 start time minute period 2
84	(#) Time channel 3 set point period 2
85	(#) Time channel 3 fan coil stage period 2
86	(#) Time channel 3 ECO mode period 1
87	(#) Time channel 3 start time hour period 3
88	(#) Time channel 3 start time minute period 3
89	(#) Time channel 3 set point period 3
90	(#) Time channel 3 fan coil stage period 3
91	(#) Time channel 3 ECO mode period 3
92	(#) Time channel 3 start time hour period 4
93	(#) Time channel 3 start time minute period 4
94	(#) Time channel 3 set point period 4
95	(#) Time channel 3 fan coil stage period 4
96	(#) Time channel 3 ECO mode period 4
97	(#) Daylight saving
98	(#) Fan coil assignment

99	(#) Max heating load
100	(#) Max cooling load
101	(#)
102	(#) Proportional band Xp
103	(#) Reset time Tn
104	(#) Minimum actuating variable
105	(#) Maximum actuating variable
106	(#) Mode Selection Control Variable
107	(#) PWM cycle time
108	(#) Heating controller type
109	(#) Cooling controller type
110	(#)
111	(#)
112	(#)
113	(#) Startup-time fan coil
114	(#) Display set point adjustment
115	(#) Special function key ON/OFF
116	(#) reserved
117	(#) reserved
118	(#) reserved
119	(#) reserved
120	(#) reserved
121	(#) reserved
122	(#) reserved
123	(#) reserved
<b>Register Data Address</b>	<b>Description</b>
255	Basic set point
256	Set point offset
257	Default presence
258	Default dew point
259	Default window contact/energy lock
260	Default change-over
261	Device On/Off
262	Release keys
263	Default alarm
264	Time hour
265	Time minute
266	Date day
267	Date month
268	Date year
269	Default controller
270	Fan coil stage

The registers marked with # are saved in EEPROM. They shall be written only during configuration of the device and not at runtime!

#### 5.4 Input Register

Modbus Input Register (R)	
Register Data Address	Description
511	Set point heating
512	Set point cooling
513	Set point offset
514	Internal temperature sensor
515	External temperature sensor
516	Output heating
517	Output cooling
518	State fan coil stage
519	State input 1
520	State input 2
521	State presence
522	State dew point
523	State window contact/energy lock
524	Actuating variable controller
525	Controller mode feedback

## 6 Configuration software

Download the latest version of the Thermokon configuration software from our website [www.thermokon.de](http://www.thermokon.de)

Via the configuration software various device settings can be easily managed by a graphical surface. Created parameter files for the different available device types (3DI and Modbus) can be stored on SD card and transferred to the device. Therefore the front part has to be removed, SD card has to be inserted (card slot on front part!) and front part plugged on again. Subsequently device restarts, reads the parameter file from the card and stores the file. Don't forget to remove the SD card!! Devices with intergrated Modbus-interface can also be configured by using the Modbus interface.

### 6.1 Connection to the PC

For connection of the JOY-RS485 Modbus and the PC an USB to RS485 Converter is needed.



Further details can be obtained from the documentation of the corresponding converter.

### 6.2 Start screen

After launching configuration software start screen appears. Device model and language can be chosen.



### 6.3 Determine firmware version

There are different parameters for various firmware versions. To have the corresponding configuration screen indicated, the firmware version that fits device firmware must be selected before main screen is faded-in.



Picture 19: Determine device firmware version

As of version 1.3.0. the firmware version can be read out in the JOY display by means of the ON/OFF button. Device must be switched-off first and switched-on again afterwards. Then, the start screen is faded-in for approx. 5 seconds. Among others, the version number is indicated. Devices with older versions must be restarted to show start screen.


For Modbus type, it is sufficient to only poll the device once (Button "Poll"). The software version is traced automatically and configuration screens are adapted accordingly. Polling must be made before changing any parameters!

Devices from firmware version 1.3.0++ indicate on start screen if an invalid parameter file is found on plugged-in SD card!

### 6.4 Overview

#### 6.4.1 Menu bar


Besides the further possibilities on loading/saving of parameters described below and the change of device types, the menu bar indicates the current device type sett, the firmware version of the device as well as the version of the configuration software.

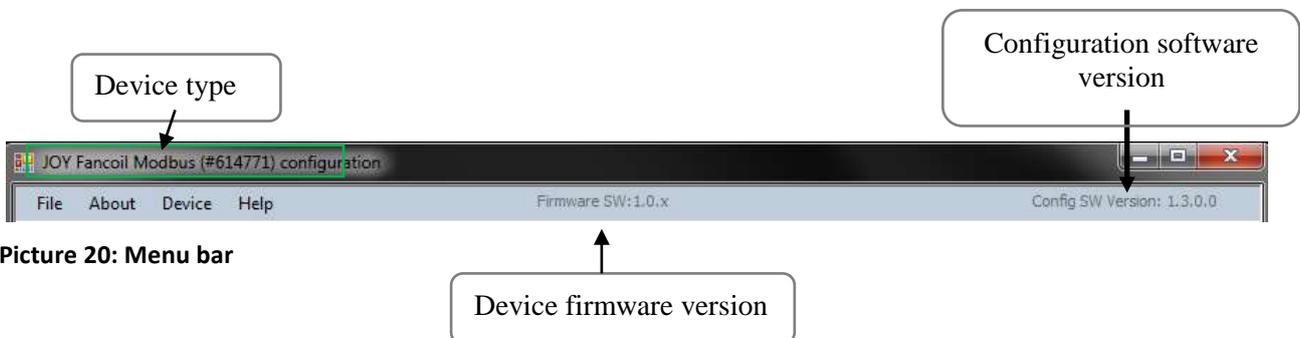

Picture 20: Menu bar

### 6.4.2 Parameter load/save


In menu bar an item "File" including sub items "Load parameter" and "Save parameter" can be found. A configuration file can be used for configuration of a device by means of a SD card. For more information see chapter [SD Card](#). The configuration files are stored under name *confJoy.csv*, so that a JOY recognizes the file on SD card as a valid configuration file!

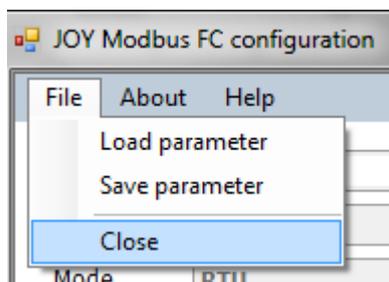

Picture 21: Menu bar

### 6.4.3 Device

Choose between different device types.

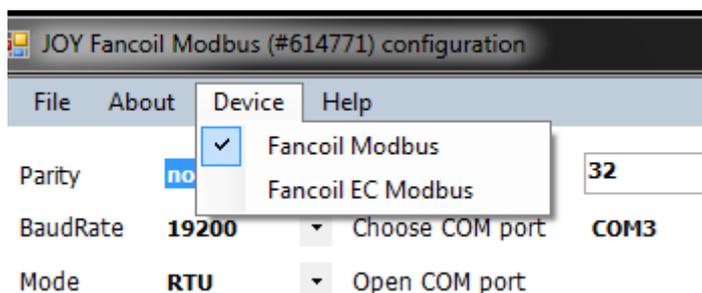


Picture 22: Change device type

If the configuration software discovers a discrepancy between user set device type and current device type during the polling the device (Modbus), the user is asked to check the device type, accordingly!

### 6.4.4 Main screen

Following the main screen appears. The main screen is divided into five areas plus menu bar.

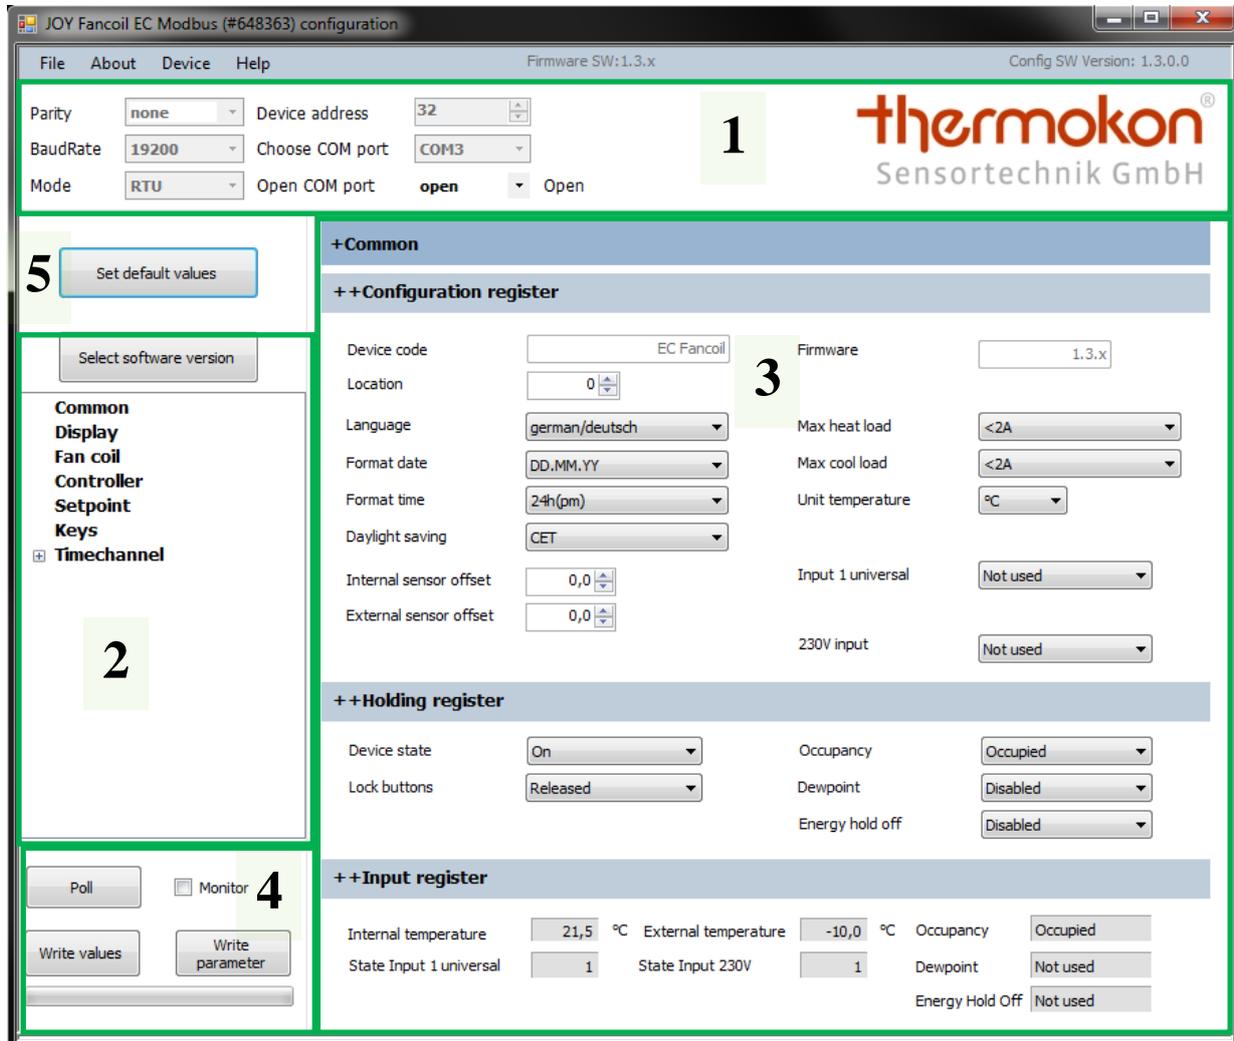

Picture 23: Change device type

1	Interface settings for modbus
2	Selection of device functions. In main window (3) the corresponding process data/parameters are displayed.
3	Main window with changeable parameters <ul style="list-style-type: none"> <li>- Configuration register: Parameters to be saved in EEPROM</li> <li>- Input register: Process data (Modbus Holding Register)</li> <li>- Output register: Process data (Modbus Input Register)</li> </ul>
4	Buttons for Modbus actions <ul style="list-style-type: none"> <li>- Read out: Single device polling</li> <li>- Monitor: Continuous device polling</li> <li>- Write values: The values mentioned under point "Holding Register" are written in the device.</li> <li>- Write parameter: The values mentioned under point "Configuration Register" are written in the device and are saved in EEPROM.</li> </ul>
5	Set default values <ul style="list-style-type: none"> <li>- All fields will be set to default values</li> </ul>

The windows 1 and 4 are faded out for types without Modbus.

## 6.5 Appendix

### 6.6 Supported Control Commands

The following MODBUS control commands are supported by JOY:

Description	Function Code	
	Hex	Dec
Read Holding Register	03 (hex)	3 (dez)
Read Input Register	04 (hex)	4 (dez)
Write multiple registers	10 (hex)	16 (dez)

Table 1 Supported Modbus Commands

## 6.7 Data Transmission

### 6.7.1 Master/Slave Protocol

One Master and one or more slaves are connected to the serial bus. Communication between Master and Slave is solely regulated by the Master. The Slaves are only allowed to transmit if they were addressed by the Master before. Slaves are only transmitting back to the Master, never to another slave.

### 6.7.2 Data Frame


Data packets are transmitted according to strictly defined defaults:

Address	Control Command	Data	Checksum
---------	-----------------	------	----------

In general a MODBUS telegram is started with the address of the slave, following a control command (e.g. read out registers) and the data. By means of the checksum at the telegram-end the bus participants can recognize transmission errors.

### 6.7.3 Transmission Mode RTU

In transmission mode RTU telegrams are separated from each other by means of transmission breaks.



The time of the transmission breaks for the separation of telegrams is depending on the adjusted baud rate and amounts to  $3,5 \cdot \text{Word-Transmission Time (11 Bit)}$ . With 9600 baud at least 4ms and with 19200 baud at least 2ms between both telegrams must pass by.

### 6.7.3.1 Telegram Structure

Address 1 Byte	Control Command 1 Byte	Data 0 - 100 Byte	Checksum	
			Low	High

### 6.7.3.2 Calculation of CRC-Checksum

The CRC-checksum (Cyclical Redundancy Check) is calculated by the sender from all bytes transmitted and attached to the message. The receiver calculates the CRC checksum again and compares the same with the checksum received. If values do not match, a transmission error is assumed and the received data packet is rejected. The low-order byte of the 16 bit checksum is sent in the telegram at the next to last position and the high-order byte at last position.

Calculation of checksum (programming example in C):

```

crc = 0xFFFF; // CRC-Check, Init
for(i = 0; i < telegram_length-2; i++)
    crc = crc_calc(crc, telegram_data[i]);

crc_low = crc & 0x00FF; // Low-Byte
crc_high = (crc & 0xFF00) >> 8; // High-Byte

// Calculate CRC
unsigned int crc_calc(unsigned int crc_temp, unsigned int data)
{
    unsigned int Index_CC=0;
    unsigned int LSB=0;
    crc_temp = (( crc_temp ^ data) | 0xFF00) & (crc_temp | 0x00FF) ;
    for(Index_CC = 0; Index_CC<8; Index_CC++)
    {
        LSB = (crc_temp & 0x0001);
        crc_temp >>= 1;
        if(LSB)
            crc_temp = crc_temp ^ 0xA001; // calculation polynomial for CRC16
    }
    return(crc_temp);
}

```